

MICREX-SX *series*

SPH

USER'S MANUAL

MULTI-RANGE ANALOG INPUT MODULE

MULTI-RANGE ANALOG OUTPUT MODULE

This User's Manual explains the system configuration, the specifications and operations of the multi-range analog input module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR) and the multi-range analog output module (NP1AYH2-MR, NP1AY02-MR) of the MICREX-SX series SPH. Read this manual carefully to ensure correct operation. When using modules or peripheral devices, be sure to read the corresponding user's manuals listed below.

Title	Manual No.	Contents
User's Manual Instructions, MICREX-SX series SPH	FEH200	Explains the memory, language and system definitions of the MICREX-SX series.
User's Manual Hardware, MICREX-SX series SPH	FEH201	Explains the system configuration, the specifications and operations of modules in the MICREX-SX series.
User's Manual T-link master module / T-link interface module, MICREX-SX series SPH	FEH204	Explains the communication specifications of the T-link, the specifications and operations of the T-link master module / the T-link interface module.
User's Manual D300win <Introduction>, MICREX-SX series	FEH250	Explains the basic operations of D300win, the programming and monitoring for MICREX-SX series.
User's Manual D300win <Reference>, MICREX-SX series	FEH251	Explains the menu and icon of D300win and all of the operations of D300win.

Notes

1. This manual may not be reproduced in whole or part in any form without prior written approval by the manufacturer.
2. The contents of this manual (including specifications) are subject to change without prior notice.
3. If you find any ambiguous or incorrect descriptions in this manual, please write them down (along with the manual No. shown on the cover) and contact FUJI.

Safety Precautions

Be sure to read the "Safety Precautions" thoroughly before using the module. Here, the safety precaution items are classified into "Warning" and "Caution."



: Incorrect handling of the device may result in death or serious injury.



: Incorrect handling of the device may result in minor injury or physical damage.

Even some items indicated by "Caution" may also result in a serious accident. Both safety instruction categories provide important information. Be sure to strictly observe these instructions.

Warning

- ◇ Never touch any part of charged circuits as terminals and exposed metal portion while the power is turned ON. It may result in an electric shock to the operator.
- ◇ Turn OFF the power before mounting, dismounting, wiring, maintaining or checking, otherwise, electric shock, erratic operation or troubles might occur.
- ◇ Place the emergency stop circuit, interlock circuit or the like for safety outside the PC. A failure of PC might break or cause problems to the machine.
- ◇ Do not connect in reverse polarity, charge (except rechargeable ones), disassemble, heat, throw in fire or short-circuit the batteries, otherwise, they might burst or take fire.
- ◇ If batteries have any deformation, spilled fluids, or other abnormality, do not use them. The use of such batteries might cause explosion or firing.
- ◇ Do not open the FG terminal with the LG-FG short circuited. (It must be grounded, otherwise it might cause electric shock.)

Safety Precautions

Caution

- ◇ Do not use one found damaged or deformed when unpacked, otherwise, failure or erratic operation might be caused.
- ◇ Do not shock the product by dropping or tipping it over, otherwise, it might be damaged or troubled.
- ◇ Follow the directions of the operating instructions when mounting the product. If mounting is improper, the product might drop or develop problems or erratic operations.
- ◇ Use the rated voltage and current mentioned in the operating instructions and manual. Use beyond the rated values might cause fire, erratic operation or failure.
- ◇ Operate (keep) in the environment specified in the operating instructions and manual. High temperature, high humidity, condensation, dust, corrosive gases, oil, organic solvents, excessive vibration or shock might cause electric shock, fire, erratic operation or failure.
- ◇ Select a wire size to suit the applied voltage and carrying current. Tighten the wire terminals to the specified torque. Inappropriate wiring or tightening might cause fire, malfunction, failure, or might cause the product to drop from its mounting.
- ◇ Contaminants, wiring chips, iron powder or other foreign matter must not enter the device when installing it, otherwise, erratic operation or failure might occur.
- ◇ Remove the dust-cover seals of modules after wiring, otherwise, fire, accidents, failure or fault might occur.
- ◇ Connect the ground terminal to the ground, otherwise, an erratic operation might occur.
- ◇ Periodically make sure the terminal screws and mounting screws are securely tightened.
Operation at a loosened status might cause fire or erratic operation.
- ◇ Put the furnished connector covers on unused connectors, otherwise, failure or erratic operation might occur.
- ◇ Install the furnished terminal cover on the terminal block, otherwise, electric shock or fire might occur.
- ◇ Sufficiently make sure of safety before program change, forced output, starting, stopping or anything else during a run. The wrong operation might break or cause machine problems.
- ◇ Engage the loader connector in a correct orientation, otherwise, an erratic operation might occur.
- ◇ Before touching the PC, discharge any static electricity that may have been collected on your body. To discharge it, touch a grounded metallic object. Static electricity might cause erratic operation or failure of the module.
- ◇ Be sure to install the electrical wiring correctly and securely, observing the operating instructions and manual. Wrong or loose wiring might cause fire, accidents, or failure.
- ◇ When disengaging the plug from the outlet, do not pull the cord, otherwise, break of cable might cause fire or failure.
- ◇ Do not attempt to change system configurations (such as installing or removing I/O modules) while the power is ON, otherwise, failure or erratic operation might occur.
- ◇ Do not attempt to repair the module by yourself -- contact your Fuji Electric agent. When replacing the batteries, correctly and securely connect the battery connectors, otherwise, fire, accidents or failure might occur.
- ◇ To clean the module, turn power off and wipe the module with a cloth moistened with warm water. Do not use thinner or other organic solvents, as the module surface might become deformed or discolored.
- ◇ Do not remodel or disassemble the product, otherwise, a failure might occur.
- ◇ Follow the regulations of industrial wastes when the device is to be discarded.
- ◇ The modules covered in these operating instructions have not been designed or manufactured for use in equipment or systems which, in the event of failure, can lead to loss of human life.
- ◇ If you intend to use the modules covered in these operating instructions for special applications, such as for nuclear energy control, aerospace, medical, or transportation, please consult your Fuji Electric agent.
- ◇ Be sure to provide protective measures when using the module covered in these operating instructions in equipment which, in the event of failure, may lead to loss of human life or other grave results.
- ◇ External power supply (such as 24V DC power supply) which is connected to DC I/O should be strongly isolated from AC power supply.

Revision

*Manual No. is shown on the cover.

Printed on	*Manual No.	Revision contents
Sep. 1998	FEH207	First edition
Sep. 2001	FEH207a	Standard analog input module NP1AX04-MR, Standard analog output module NP1AY02-MR, and 8 channels standard analog input module NP1AX08-MR specifications added.

Preface

Safety Precautions

Revision

Contents

	Page
Section 1 General	1-1
1-1 General	1-1
1-1-1 Analog input module	1-1
1-1-2 Analog output module	1-1
Section 2 Specifications	2-1
2-1 General Specifications	2-1
2-2 Performance/Function Specifications	2-2
2-2-1 Analog input module	2-2
2-2-2 Analog output module	2-4
2-3 I/O Characteristics of Analog Input Module	2-6
2-3-1 Voltage input characteristics	2-6
2-3-2 Current input characteristics	2-7
2-4 I/O Characteristics of Analog Output Module	2-8
2-4-1 Voltage output characteristics	2-8
2-4-2 Current output characteristics	2-9
2-5 Overall Accuracy	2-10
2-5-1 Overall accuracy of analog input module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)	2-10
2-5-2 Overall accuracy of analog output module (NP1AYH2-MR, NP1AY02-MR)	2-11
2-6 Resolution	2-12
2-6-1 Analog input module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)	2-12
2-6-2 Resolution of analog output module (NP1AYH2-MR, NP1AY02-MR)	2-12
2-7 Conversion Method	2-13
2-7-1 Conversion method of analog input module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)	2-13
2-7-2 Conversion method of analog output module (NP1AYH2-MR, NP1AY02-MR)	2-13
2-8 Names and Functions	2-14
2-8-1 Analog input module (NP1AXH4-MR/NP1AX04-MR/NP1AX08-MR)	2-14
2-8-2 Analog output module (NP1AYH2-MR, NP1AY02-MR)	2-16
2-9 Dimensions	2-17
Section 3 System Configuration	3-1
3-1 Mounting on Base Board	3-1
3-1-1 Mounting position	3-1
3-1-2 Number of mountable modules	3-1
Section 4 Software Interface	4-1
4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)	4-1
4-1-1 Memory assignment	4-1
4-1-2 Operation setting procedure	4-9
4-1-3 Scaling data setting procedure	4-11

Contents

	Page
4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)	4-13
4-2-1 Memory assignment	4-13
4-2-2 Operation setting procedure	4-17
4-2-3 Test output procedure	4-18
4-2-4 Scaling data setting procedure	4-19
Section 5 Wiring	5-1
5-1 Wiring Precautions	5-1
5-2 Wiring of Analog Input Module	5-2
5-2-1 Terminal arrangement (NP1AXH4-MR, NP1AX04-MR)	5-2
5-2-2 Wiring example	5-2
5-3 Wiring of Analog Input Module (NP1AX08-MR)	5-3
5-3-1 Terminal arrangement	5-3
5-3-2 Wiring example	5-3
5-4 Wiring of Analog Output Module	5-4
5-4-1 Terminal arrangement (NP1AYH2-MR, NP1AY02-MR)	5-4
5-4-2 Wiring example	5-4
Section 6 Gain/Offset Adjustment	6-1
6-1 Gain/Offset Adjustment	6-1
6-1-1 Gain/offset values of analog input module (NP1AXH4-MR, NP1AX04-MR)	6-1
6-1-2 Gain/offset values of analog output module (NP1AYH2-MR, NP1AY02-MR)	6-2
6-2 Adjustment Procedure for Analog Input Module (NP1AXH4-MR, NP1AX04-MR)	6-3
6-3 Adjustment Procedure for Analog Output Module (NP1AYH2-MR, NP1AY02-MR)	6-4

Section 1 General

	Page
1-1 General	1-1
1-1-1 Analog input module	1-1
1-1-2 Analog output module	1-1

Section 1 General

1-1 General

The MICREX-SX series SPH Multi-range Analog Input/Output Modules are used mounted on the SPH base board.

1-1-1 Analog input module

This module converts an analog signal (voltage or current input) which is input from outside the PC to a digital value of INT type (integer). It is possible to set voltage input or current input and an input range for each channel of the module.

High-speed analog input module: NP1AXH4-MR (4 channels)

Standard analog input module: NP1AX04-MR (4 channels)

Standard analog input module: NP1AX08-MR (8 channels)

1-1-2 Analog output module

This module converts integer (INT) type data (input value) set from the CPU module into an analog voltage signal or analog current signal and outputs them to an external device. It is possible to set a voltage output or current output and an output range for each channel of the module.

High-speed analog output module: NP1AYH2-MR (2 channels)

Standard analog output module: NP1AY02-MR (2 channels)

Note: NP1AX08-MR of 8-channel input specification cannot be mounted on the baseboard for remote I/O, such as those for T-link and OPCN-1.

Section 2 Specifications

	Page
2-1 General Specifications	2-1
2-2 Performance/Function Specifications	2-2
2-2-1 Analog input module	2-2
(1) High-speed analog input (NP1AXH4-MR)	2-2
(2) Standard analog input (NP1AX04-MR, NP1AX08-MR)	2-3
2-2-2 Analog output module	2-4
(1) High-speed analog output (NP1AYH2-MR)	2-4
(2) Standard analog output (NP1AY02-MR)	2-5
2-3 I/O Characteristics of Analog Input Module	2-6
2-3-1 Voltage input characteristics	2-6
2-3-2 Current input characteristics	2-7
2-4 I/O Characteristics of Analog Output Module	2-8
2-4-1 Voltage output characteristics	2-8
2-4-2 Current output characteristics	2-9
2-5 Overall Accuracy	2-10
2-5-1 Overall accuracy of analog input module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)	2-10
2-5-2 Overall accuracy of analog output module (NP1AYH2-MR, NP1AY02-MR)	2-11
2-6 Resolution	2-12
2-6-1 Analog input module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)	2-12
(1) Resolution	2-12
(2) Relationship between maximum resolution and digital output value	2-12
2-6-2 Resolution of analog output module (NP1AYH2-MR, NP1AY02-MR)	2-12
(1) Analog output value	2-12
(2) Relationship between maximum resolution and analog output value	2-12
2-7 Conversion Method	2-13
2-7-1 Conversion method of analog input module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)	2-13
2-7-2 Conversion method of analog output module (NP1AYH2-MR, NP1AY02-MR)	2-13
2-8 Names and Functions	2-14
2-8-1 Analog input module (NP1AXH4-MR/NP1AX04-MR/NP1AX08-MR)	2-14
(1) Names	2-14
(2) Functions	2-15
2-8-2 Analog output module (NP1AYH2-MR, NP1AY02-MR)	2-16
(1) Names	2-16
(2) Functions	2-16
2-9 Dimensions	2-17

Item		Specification
Physical environmental conditions	Operating ambient temperature	0 to 55° C
	Storage temperature	-25 to +70° C
	Relative humidity	20% to 95% RH; no condensation
	Pollution degree	2
	Corrosion immunity	Free from corrosive gases. Not stained with organic solvents.
	Operating altitude	2,000m or less above sea level (Transport condition: 70kPa or higher)
Mechanical service conditions	Vibration	Half amplitude: 0.15mm, constant acceleration: 19.6m/s ² Two hours for each of three mutually perpendicular axes, total six hours.
	Shock	Acceleration peak: 147m/s ² Three times for each of three mutually perpendicular axes.
Electrical service conditions	Noise immunity	1.5kV, rise time 1ns, pulse width 1μs (noise simulator)
	Electrostatic discharge	Contact discharge: ± 8kV, aerial discharge: ± 15kV
	Radioelectromagnetic field	10V/m (80MHz to 1000MHz)
Construction		Panel-mounted type (IP30)
Cooling		Air cooling
Insulation method		Photocoupler (no insulation between channels)
Dielectric strength		500V AC, one minute (between I/O terminals and frame ground)
Insulation resistance		10MΩ or more with 500V DC megger(between I/O terminals and frame ground)
Internal current consumption at 24V DC		NP1AXH4-MR : 120mA or less (high speed analog input) NP1AX04-MR : 120mA or less (standard analog input) NP1AX08-MR : 120mA or less (standard analog input 8 channels) NP1AYH2-MR : 120mA or less (high speed analog output) NP1AY02-MR : 120mA or less (standard analog output)
Mass		NP1AXH4-MR : Approx. 200g (high speed analog input) NP1AX04-MR : Approx. 200g (standard analog input) NP1AX08-MR : Approx. 200g (standard analog input 8 channels) NP1AYH2-MR : Approx. 200g (high speed analog output) NP1AY02-MR : Approx. 200g (standard analog output)
Dimensions		Refer to Section 2-9.

2-2-1 Analog input module

(1) High-speed analog input (NP1AXH4-MR)

Item	Specification										
Type	NP1AXH4-MR										
No. of input channels	4 channels										
Input impedance	Voltage input: 1MΩ or more, Current input: 250Ω or less										
Input tolerance	Voltage input: ± 15V (one minute), Current input: ± 30mA (one minute)										
Conversion characteristics (Note 1)	<table border="1"> <thead> <tr> <th>Input</th> <th>Analog input range</th> <th>Digital output value</th> </tr> </thead> <tbody> <tr> <td>Voltage (V)</td> <td>-10 to 10, -5 to 5, 1 to 5, 0 to 5, 0 to 10</td> <td>-8000 to 8000 or 0 to 16000</td> </tr> <tr> <td>Current (mA)</td> <td>0 to 20, 4 to 20, -20 to 20</td> <td></td> </tr> </tbody> </table>		Input	Analog input range	Digital output value	Voltage (V)	-10 to 10, -5 to 5, 1 to 5, 0 to 5, 0 to 10	-8000 to 8000 or 0 to 16000	Current (mA)	0 to 20, 4 to 20, -20 to 20	
Input	Analog input range	Digital output value									
Voltage (V)	-10 to 10, -5 to 5, 1 to 5, 0 to 5, 0 to 10	-8000 to 8000 or 0 to 16000									
Current (mA)	0 to 20, 4 to 20, -20 to 20										
Resolution	14 bits										
Overall accuracy (for full scale)	± 0.1% or lower (at 25° C), ± 1.0% or lower (at 0° C to 55° C)										
Digital output format	INT type (integer)										
Sampling time	1ms/4 channels										
Input filtering time	47μs										
Input delay time	1ms + Takt cycle										
Wire connections	External wiring connections	Detachable screw terminal block (M3) 20 poles									
	Applicable wire size	AWG #22 to 18 (Note 2)									
	Treatment of terminals not used	Short-circuited (between V, I and COM)									
Status indication	ONL: indicates normal condition (green LED), ERR: indicates abnormal condition (red LED), SETTING: remains on or blinks during setting operation (green LED).										
Gain/offset adjustment	By switch or program (Note 3)										
Voltage/current selection	By changing the terminal block connection (for each channel)										
Other functions	<ul style="list-style-type: none"> • A/D conversion enable/disable (by application program) • Conversion data averaging (by application program) • Pre-alarming (by application program) • Scaling (by application program) 										
Occupied slot	1 slot										
Occupied words	10 words (input: 8 words, output: 2 words)										

Note: 1) Use an application program to set the desired analog input range. For details, refer to "Section 4 Software Interface."
(The analog input range factory setting is ± 10V.)

2) The applicable wire size depends on the crimp terminal used. For details, refer to "5-1 Wiring Precautions."

3) For the method of gain/offset adjustment, refer to "Section 6 Gain/Offset Adjustment."

(2) Standard analog input (NP1AX04-MR, NP1AX08-MR)

Item		Specification	
Type		NP1AX04-MR	NP1AX08-MR
No. of input channels		4 channels	8 channels
Input impedance		Voltage input: 2M Ω , Current input: 250 Ω	
Input tolerance		Voltage input: \pm 15V (one minute), Current input: \pm 30mA (one minute)	
Conversion characteristics (Note 1)		Input	Analog input range
		Voltage (V)	-10 to 10, -5 to 5, 1 to 5, 0 to 5, 0 to 10
		Current (mA)	0 to 20, 4 to 20, -20 to 20
		Digital output value	
		-500 to 500 or 0 to 1000	
Resolution		10 bits	
Overall accuracy (for full scale)		\pm 0.5% or lower (at 25 $^{\circ}$ C), \pm 1.0% or lower (at 0 $^{\circ}$ C to 55 $^{\circ}$ C)	
Digital output format		INT type (integer)	
Sampling time		4ms/4 channels	1ms + 0.5ms x No. of conversion enabl channels
Input filtering time		47 μ s (hardware)	
Input delay time		4ms + Takt time	Sampling cycle + Takt time
Wire connections	External wiring connections	Detachable screw terminal block (M3) 20 poles	
	Applicable wire size	AWG #22 to 18	(Note 2)
	Treatment of terminals not used	Short-circuited (between V, I and COM)	
Status indication		ONL: indicates normal condition (green LED), ERR: indicates abnormal condition (red LED), SETTING: remains on or blinks during setting operation (green LED).	
Gain/offset adjustment		By switch or program	(Note 3)
Voltage/current selection		By changing the terminal block connection (for each channel)	
Other functions		<ul style="list-style-type: none"> • A/D conversion enable/disable (by application program) • Conversion data averaging (by application program) • Pre-alarmed (by application program) 	
Occupied slot		1 slot	
Occupied words		10 words (input: 8 words, output: 2 words)	18 words (input: 16 words, output: 2 words)

Note: 1) Use an application program to set the desired analog input range. For details, refer to "Section 4 Software Interface."
(The analog input range factory setting is \pm 10V.)

2) The applicable wire size depends on the crimp terminal used. For details, refer to "5-1 Wiring Precautions."

3) For the method of gain/offset adjustment, refer to "Section 6 Gain/Offset Adjustment."

2-2-2 Analog output module

(1) High-speed analog output (NP1AYH2-MR)

Item	Specification									
Type	NP1AYH2-MR									
No. of output channels	2 channels									
External load resistance	Voltage output: 1kΩ or more, Current output: 600Ω or less									
Conversion characteristics (Note 1)	<table border="1"> <thead> <tr> <th>Output</th> <th>Digital input value</th> <th>Analog output range</th> </tr> </thead> <tbody> <tr> <td>Voltage (V)</td> <td>-8000 to 8000</td> <td>-10 to 10, -5 to 5, 1 to 5, 0 to 5, 0 to 10</td> </tr> <tr> <td>Current (mA)</td> <td>or 0 to 16000</td> <td>0 to 20, 4 to 20</td> </tr> </tbody> </table>	Output	Digital input value	Analog output range	Voltage (V)	-8000 to 8000	-10 to 10, -5 to 5, 1 to 5, 0 to 5, 0 to 10	Current (mA)	or 0 to 16000	0 to 20, 4 to 20
Output	Digital input value	Analog output range								
Voltage (V)	-8000 to 8000	-10 to 10, -5 to 5, 1 to 5, 0 to 5, 0 to 10								
Current (mA)	or 0 to 16000	0 to 20, 4 to 20								
Resolution	14 bits									
Overall accuracy (for full scale)	± 0.1% or lower (at 25° C), ±1.0% or lower (at 0° C to 55° C)									
Digital input type	INT (integer)									
Output delay time	1ms + Takt time									
Wire connections	External wire connections	Detachable screw terminal block (M3) 20 poles								
	Applicable wire size	AWG #22 to 18 (Note 2)								
	Treatment of output terminals not used	Open								
Status indication	ONL: indicates normal condition (green LED), ERR: indicates abnormal condition (red LED), SETTING: remains on or blinks during setting operation (green LED).									
Gain/offset adjustment	By switch or program (Note 3)									
Voltage/current selection	By changing the terminal block connection (for each channel)									
Other functions	<ul style="list-style-type: none"> Analog output enable/disable (by application program) Negative value output enable/disable (by application program) Test output (by application program) Scaling (by application program) 									
Occupied slot	1 slot									
Occupied words	6 words (input: 2 words, output: 4 words)									

Note: 1) Use an application program to set the desired analog output range. For details, refer to "Section 4 Software Interface." (The analog output range factory setting is 1 to 5V.)

2) The applicable wire size depends on the crimp terminal used. For details, refer to "5-1 Wiring Precautions."

3) For the method of gain/offset adjustment, refer to "Section 6 Gain/Offset Adjustment."

(2) Standard analog output (NP1AY02-MR)

Item		Specification									
Type		NP1AY02-MR									
No. of output channels		2 channels									
External load resistance		Voltage output: 1k Ω or more, Current output: 600 Ω or less									
Conversion characteristics (Note 1)		<table border="1"> <thead> <tr> <th>Output</th> <th>Digital input value</th> <th>Analog output range</th> </tr> </thead> <tbody> <tr> <td>Voltage (V)</td> <td>-500 to 500</td> <td>-10 to 10, -5 to 5, 1 to 5, 0 to 5, 0 to 10</td> </tr> <tr> <td>Current (mA)</td> <td>or 0 to 1000</td> <td>0 to 20, 4 to 20</td> </tr> </tbody> </table>	Output	Digital input value	Analog output range	Voltage (V)	-500 to 500	-10 to 10, -5 to 5, 1 to 5, 0 to 5, 0 to 10	Current (mA)	or 0 to 1000	0 to 20, 4 to 20
Output	Digital input value	Analog output range									
Voltage (V)	-500 to 500	-10 to 10, -5 to 5, 1 to 5, 0 to 5, 0 to 10									
Current (mA)	or 0 to 1000	0 to 20, 4 to 20									
Resolution		10 bits									
Overall accuracy (for full scale)		$\pm 0.5\%$ or lower (at 25° C), $\pm 1.0\%$ or lower (at 0° C to 55° C)									
Digital input type		INT (integer)									
Output delay time		2ms									
Wire connections	External wire connections	Detachable screw terminal block (M3) 20 poles									
	Applicable wire size	AWG #22 to 18 (Note 2)									
	Treatment of output terminals not used	Open									
Status indication		ONL: indicates normal condition (green LED), ERR: indicates abnormal condition (red LED), SETTING: remains on or blinks during setting operation (green LED).									
Gain/offset adjustment		By switch or program (Note 3)									
Voltage/current selection		By changing the terminal block connection (for each channel)									
Other functions		<ul style="list-style-type: none"> Analog output enable/disable (by application program) Negative value output enable/disable (by application program) Test output (by application program) 									
Occupied slot		1 slot									
Occupied words		6 words (input: 2 words, output: 4 words)									

Note: 1) Use an application program to set the desired analog output range. For details, refer to "Section 4 Software Interface." (The analog output range factory setting is 1 to 5V.)

2) The applicable wire size depends on the crimp terminal used. For details, refer to "5-1 Wiring Precautions."


3) For the method of gain/offset adjustment, refer to "Section 6 Gain/Offset Adjustment."

With NP1AXH4-MR, NP1AX04-MR or NP1AX08-MR, it is possible to select voltage/current input for each channel. (Refer to section 5-2 to 5-4)

2-3-1 Voltage input characteristics

Analog input voltage range	Offset	Gain	Output value NP1AXH4-MR	Output value NP1AX04-MR NP1AX08-MR	I/O characteristics
-10 to 10V	0V	10V	± 8000	± 500	Analog input voltage characteristic 1)
-5 to 5V	0V	5V	± 8000	± 500	Analog input voltage characteristic 2)
1 to 5V	1V	5V	0 to 16000	0 to 1000	Analog input voltage characteristic 3)
0 to 5V	0V	5V	0 to 16000	0 to 1000	Analog input voltage characteristic 4)
0 to 10V	0V	10V	0 to 16000	0 to 1000	Analog input voltage characteristic 5)

Analog input voltage characteristics

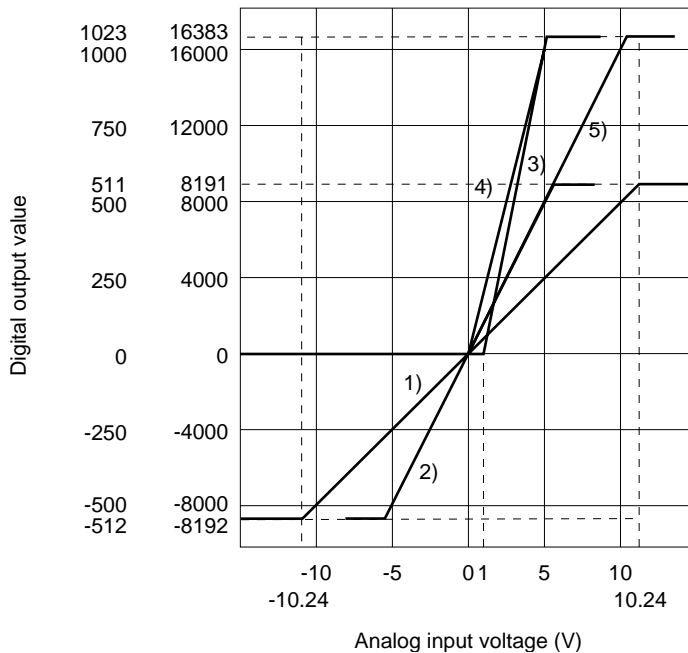


Notes:

- If the input voltage is such that the output value of NP1AXH4-MR becomes out of the range from -8192 to $+8191$ or 16383 or that the output value of NP1AX04-MR or NP1AX08-MR becomes out of the range from -512 to $+511$ or 1023 , the digital output value is fixed to -8192 , $+8191$ or 16383 for NP1AXH4-MR, or fixed to -512 , $+511$ or 1023 for NP1AX04-MR/NP1AX08-MR.
- If the input voltage is higher than $10.24V$ or lower than $-10.24V$, the accuracy of the digital output value is not guaranteed.
- Do not input a voltage which is outside $\pm 15V$. It can destroy elements inside the module.

2-3-2 Current input characteristics

Analog input current range	Offset	Gain	Output value NP1AXH4-MR	Output value NP1AX04-MR NP1AX08-MR	I/O characteristics
4 to 20mA	4V	20mA	0 to 16000	0 to 1000	Analog input current characteristic 1)
0 to 20mA	0V	20mA	0 to 16000	0 to 1000	Analog input current characteristic 2)
-20 to 20mA	0V	20mA	± 8000	± 500	Analog input current characteristic 3)

Analog input current characteristics

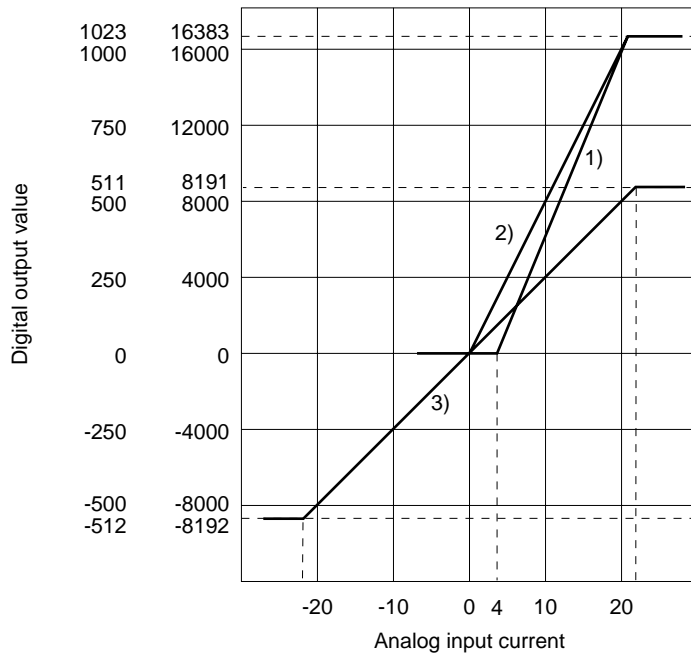

Notes:


- If the input current is such that the output of the NP1AXH4-MR is outside -8192 to +8191 or greater than 16383, or if the input current is such that the output of the NP1AX04-MR/NP1AX08-MR are outside -512 to +511 or greater than 1023, when the NP1AXH4-MR, the digital output value is fixed to -8192, and +8191 or 16383, when the NP1AX04-MR/NP1AX08-MR, the digital output value are fixed to -512, and +511 or 1023.
- During factory shipment, the module is adjusted using a specific voltage range. Because of this, when current input is used, the digital output value is subject to slight deviation.
When current input is used, therefore, it is advisable to adjust the gain and offset.
- Do not input a voltage which is outside ± 30mA. It can destroy elements inside the module.

With the NP1AYH2-MR and NP1AY02-MR, there are possible to select either voltage output or current output for each channel by appropriate wiring to the terminal block.

2-4-1 Voltage output characteristics

Analog output voltage range	Offset	Gain	Input value NP1AYH2-MR	Input value NP1AY02-MR	I/O characteristics
0 to 10V	0V	10V	0 to 16000	0 to 1000	Analog output voltage characteristic 1)
0 to 5V	0V	5V	0 to 16000	0 to 1000	Analog output voltage characteristic 2)
1 to 5V	1V	5V	0 to 16000	0 to 1000	Analog output voltage characteristic 3)
± 5V	0V	5V	± 8000	± 500	Analog output voltage characteristic 4)
± 10V	0V	10V	± 8000	± 500	Analog output voltage characteristic 5)

Analog output voltage characteristics

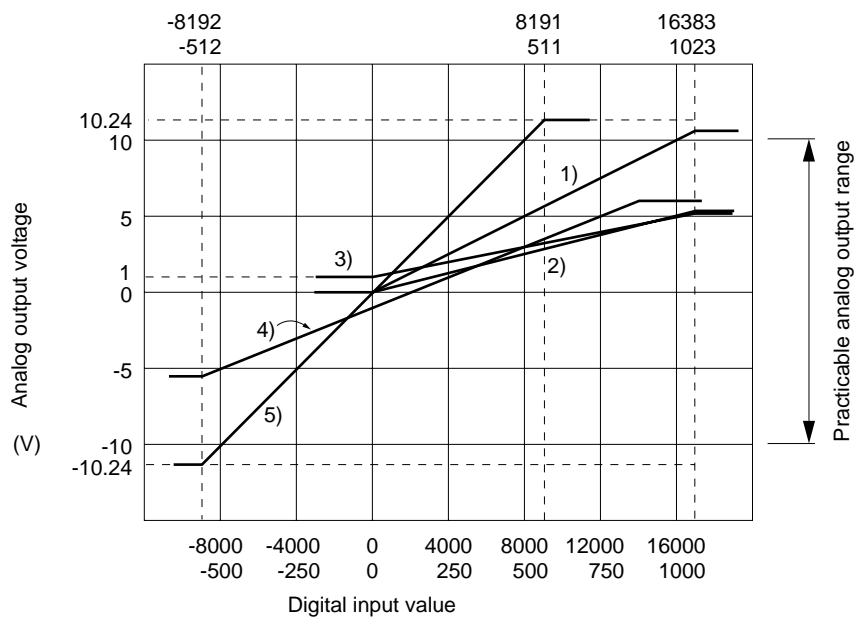


Notes:

- When the input value of the NP1AYH2-MR is outside -8192 to +8191 or greater than 16383, or when the input value of the NP1AY02-MR is outside -512 to +511 or greater than 1023, the output value is fixed to 10.24V or -10.24V.

2-4-2 Current output characteristics

Analog output current range	Offset	Gain	Input value NP1AYH2-MR	Input value NP1AY02-MR	I/O characteristics
0 to 20mA	0mA	20mA	0 to 16000	0 to 1000	Analog output current characteristic 1)
4 to 20mA	4mA	20mA	0 to 16000	0 to 1000	Analog output current characteristic 2)

Analog output current characteristics

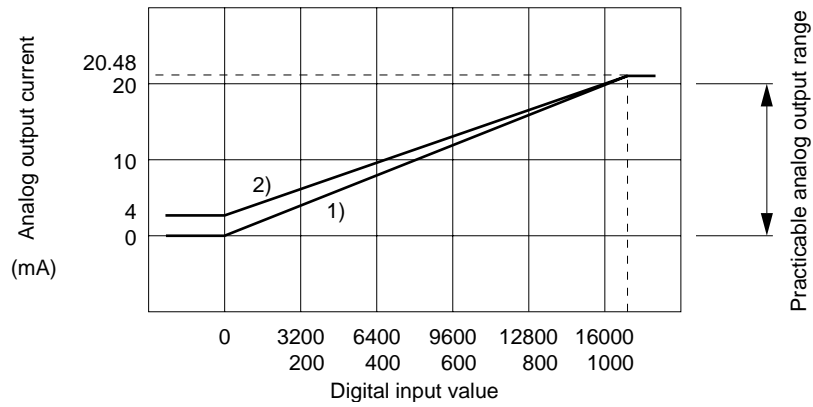

Notes:

- Even if a digital input value greater than 1023 or 16383 is set, it is fixed to 20.48mA.
- The NP1AYH2-MR is adjusted using the factory setting output voltage range of 1V to 5V. When using current output, therefore, adjust the gain and offset.

2-5 Overall Accuracy

2-5-1 Overall accuracy of analog input module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

The overall accuracy of A/D conversion is as follows.


- NP1AXH4-MR ... $\pm 0.1\%$ (at 25°C), $\pm 1.0\%$ (full scale)
- NP1AX04-MR, NP1AX08-MR ... $\pm 0.5\%$ (at 25°C), $\pm 1.0\%$ (full scale)

Note: The above overall accuracy is guaranteed when the input is within the practicable input range.

Example 1)

When the input characteristic is set to voltage input (-10V to 10V)


Overall accuracy (when voltage input is used)

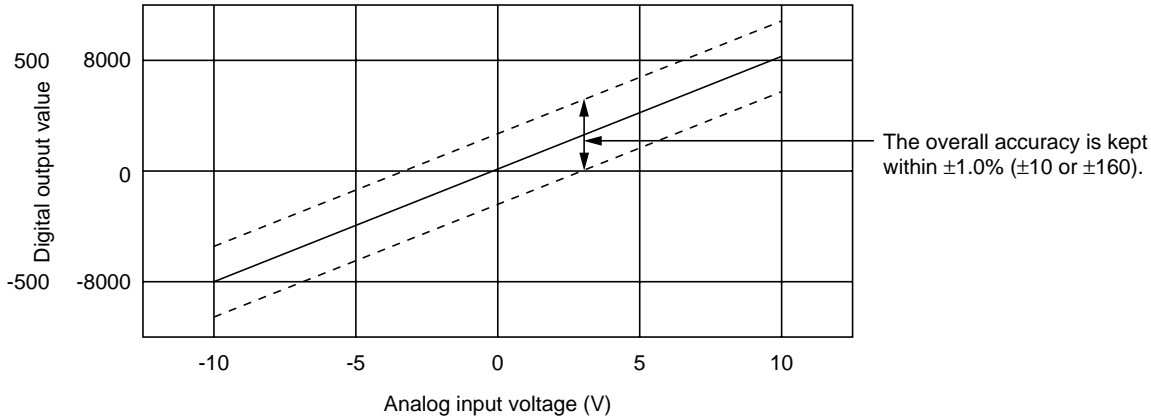

Example 2)

When the input characteristic is set to current input (-20A to 20A)

Overall accuracy (when current input is used)

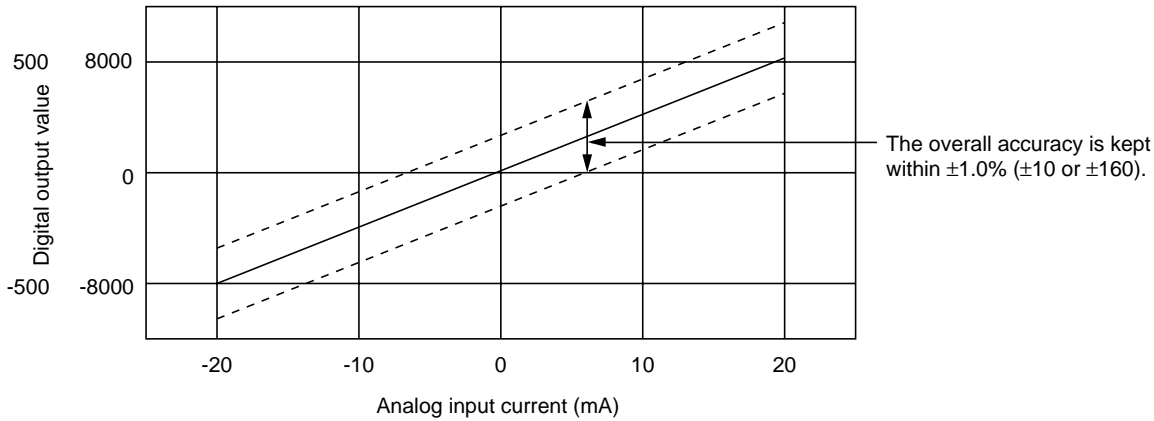

Notes:

(1) Digital output value

NP1AXH4-MR: ± 8000

NP1AX04-MR, NP1AX08-MR: ± 500

(2) The overall accuracy for full scale is calculated as follows.

1) $\{500 - (-500)\} \times 0.01 = 10$, 2) $\{8000 - (-8000)\} \times 0.01 = 160$

Thus, the variance in digital output are within, 1) ± 10 , and 2) ± 160 .

2-5-2 Overall accuracy of analog output module (NP1AYH2-MR, NP1AY02-MR)

The overall accuracy of D/A conversion is as follows.


- NP1AYH2-MR ... $\pm 0.1\%$ (at 25°C), $\pm 1.0\%$ (full scale)
- NP1AY02-MR ... $\pm 0.5\%$ (at 25°C), $\pm 1.0\%$ (full scale)

Note: The above overall accuracy is guaranteed when the input is within the practicable input range.

Example 1)

When the output characteristic is set to voltage output (-10 to 10V)


Overall accuracy (when voltage output is used)

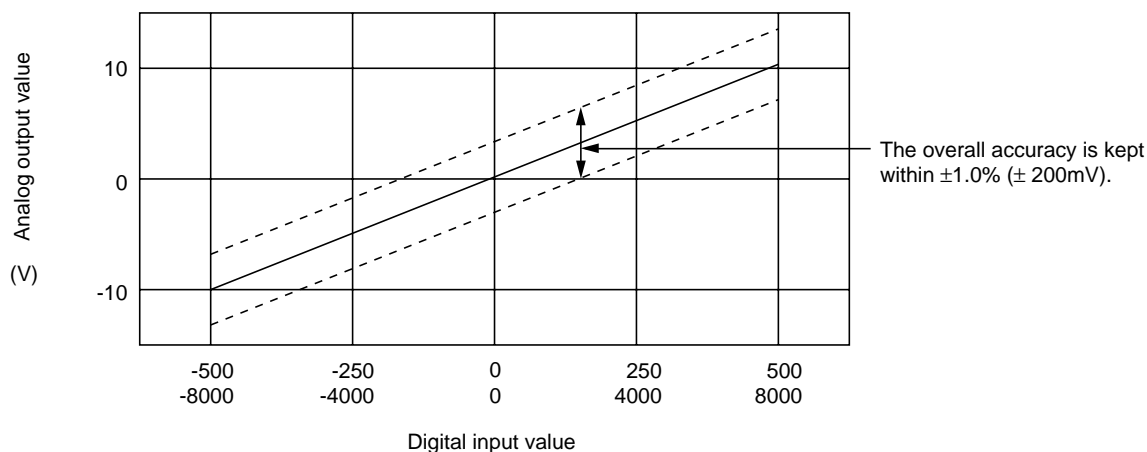

Example 2)

When the output characteristic is set to current output (0 to 20mA)

Overall accuracy (when current output is used)

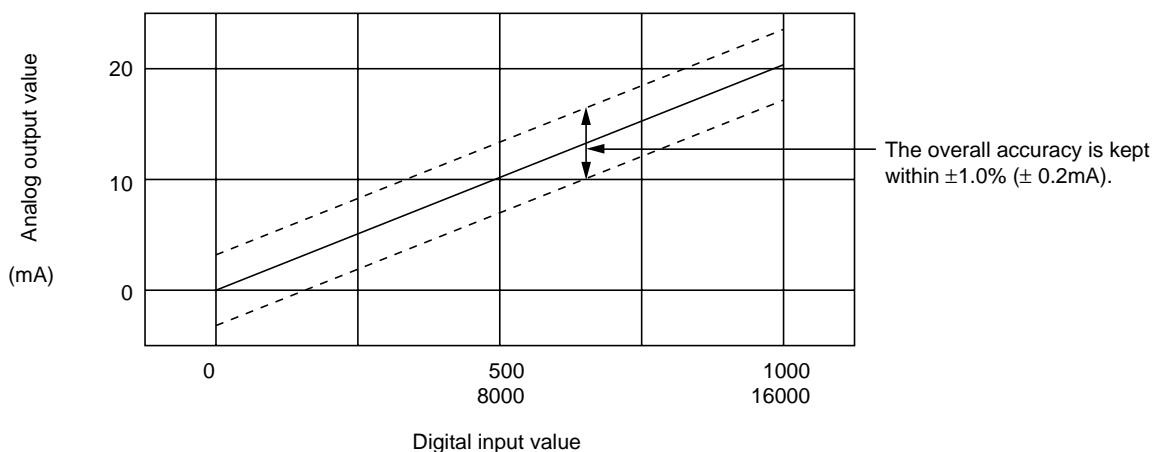

Notes:

(1) Digital input value

NP1AYH2-MR: ± 8000

NP1AY02-MR: ± 500

(2) The overall accuracy for full scale is calculated as follows.

$\{10 - (-10)\} \times 0.01 = 0.2 \text{ (V)} = 200\text{mV}$voltage output

$\{20 - (0)\} \times 0.01 = 0.2 \text{ (mA)}$current output

Thus, the variance is $\pm 0.2 \text{ (V)}$ for voltage output and $\pm 0.2 \text{ (mA)}$ for current output.

2-6-1 Analog input module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

The resolution can be freely changed by gain/offset adjustment.

The relationship between gain/offset adjustment and digital output value is as follows.

Fine adjustment is not available with NP1AX08-MR. (This module is already adjusted at shipment and therefore can be used only by range setting.)

(1) Resolution

Resolution is obtained by the following expression.

$$\text{Resolution} = \frac{(\text{Gain}) - (\text{Offset})}{\text{Digital output value range}} \quad (\text{mV or } \mu\text{A})$$

(2) Relationship between maximum resolution and digital output value

For example, because maximum resolution of 0.5V range is 0.3125 mV in voltage and 1 μ A in current for the analog input module (NP1AXH4-MR), and 5 mV in voltage and 20 μ A in current for NP1AX04-MR, respectively, digital output value may not always increase or decrease by ones if the following relation is met.

$$\frac{(\text{Gain}) - (\text{Offset})}{\text{Digital output value range}} < \text{Max. resolution}$$

Example

$$\frac{(\text{Gain} = 5\text{V}) - (\text{Offset} = 1\text{V})}{\text{Digital output value range} = 16000} = 0.25\text{mV} < \text{Max. resolution } 0.3125\text{mV}$$

The digital output value increases (decreases) by 1 as the input voltage is increased (decreased) by 0.3125mV. When the change in input voltage is 0.25mV, the digital output value does not change by 1.

2-6-2 Resolution of analog output module (NP1AYH2-MR, NP1AY02-MR)**(1) Analog output value**

The resolution can be freely changed by gain/offset adjustment.

The relationship between gain/offset adjustment and analog output value is as follows.

$$\text{Analog output value} = \frac{(\text{Gain}) - (\text{Offset})}{\text{Digital value resolution}} \times \text{Digital input value} + \text{Offset}$$

(2) Relationship between maximum resolution and analog output value

For example, because maximum resolution of the analog output module (NP1AYH2-MR) is 0.3125mV for voltage output and 1 μ A for current output. Therefore, if the gain/offset settings make the following expression hold true, the change of analog output value when the digital input value is changed by 1 may be different from the one calculated by the above expression.


$$\frac{(\text{Gain}) - (\text{Offset})}{\text{Digital value resolution}} < \text{Max. resolution}$$

Example

$$\frac{(\text{Gain} = 5\text{V}) - (\text{Offset} = 1\text{V})}{\text{Digital value resolution} = 1000} = 4\text{mV} < (\text{Max. resolution } 5\text{mV})$$

2-7-1 Conversion method of analog input module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

With the analog input module, the digital output value is determined by the settings of input/output characteristics and A/D conversion method.



The set values of offset and gain determine the digital output value for an analog input (voltage/current) value.


Offset ...

The input voltage/current value that makes the digital output value 0.

Gain

The input voltage/current value that makes the digital output value 8000 or 16000 (NP1AXH4-MR).

The input voltage/current value that makes the digital output value 500 or 1000 (NP1AX08-MR, NP1AX04-MR).



Set either sampling process or averaging process for each channel.

1) Sampling process

In this process, digital output values which are obtained by A/D conversion of analog input values sequentially are stored in the area for digital output values.

2) Averaging process

In this process, A/D conversion is performed a set number of times for a channel specified by the CPU and the average of A/D-converted values, excluding the maximum and minimum values, is calculated and stored in the area for digital output values. It should be noted that when the set number of times of A/D conversion is 2 or less, a sampling process, not an averaging process, is performed.

Number of times of A/D conversion that can be set for averaging process ...


1 to 128 (NP1AXH4-MR, NP1AX04-MR), 1 to 64 (NP1AX08-MR)

Notes:

- Setting a number outside the range shown above results in an error. In this case, the contents of the buffer memory remain unchanged and the A/D conversion for the averaging process before the setting error has occurred is performed.

2-7-2 Conversion method of analog output module (NP1AYH2-MR, NP1AY02-MR)

With the analog output module, the analog output (voltage or current) value is determined by the settings of input/output characteristics.



The set values of gain and offset determine the analog output (voltage/current) value for a digital input value.

Offset ...

The analog output voltage/current value when the value to be D/A-converted is 0.

Gain

The analog output voltage/current value when the value to be D/A-converted is 8000 or 16000 (NP1AYH2-MR).


The analog output voltage/current value when the value to be D/A-converted is 500 or 1000 (NP1AY02-MR).

2-8 Names and Functions


2-8-1 Analog input module (NP1AXH4-MR/NP1AX04-MR/NP1AX08-MR)

(1) Names

<NP1AXH4-MR/NP1AX04-MR>

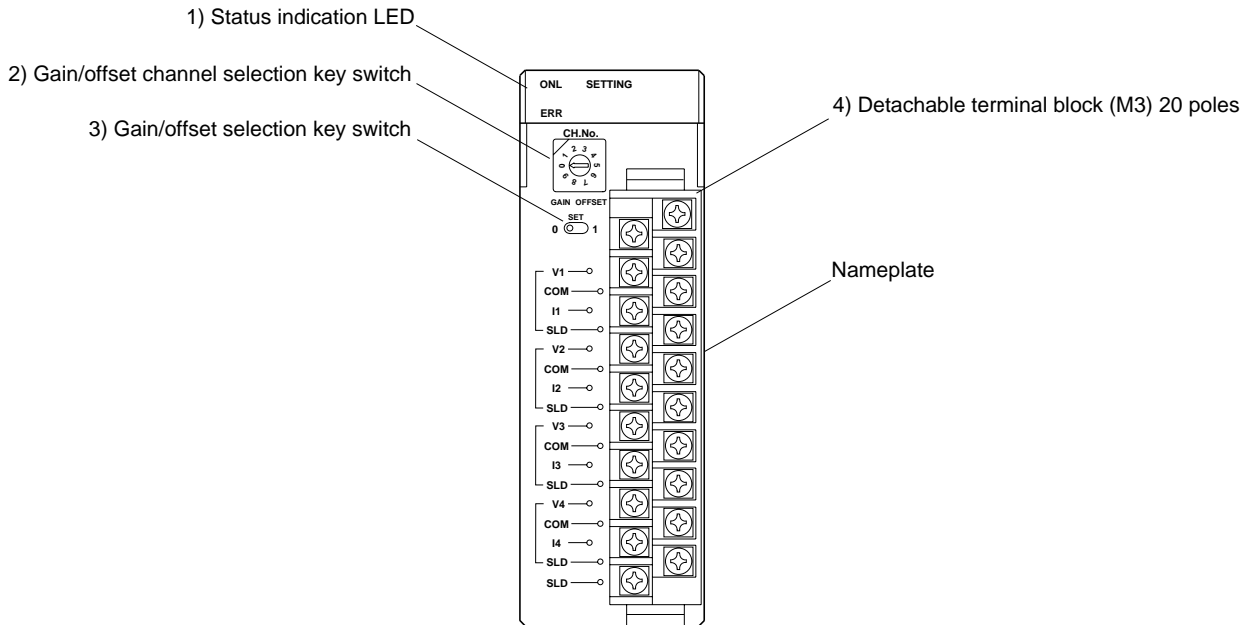


<NP1AX08-MR>

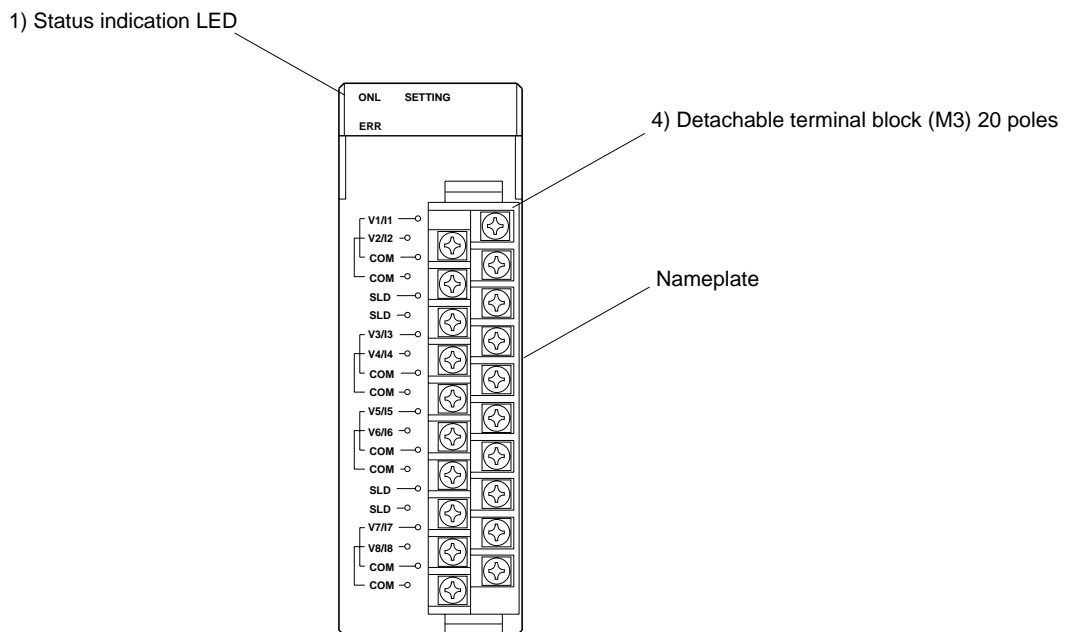

(2) Functions


1) Status indication LED

Indicates the condition of the analog input module.




Symbol	Color	Status Description
ONL	Green	Lights on when local module is operating normally; blinks while connecting to SX bus.
ERR	Red	Lights on when local module is abnormal.
SETTING	Green	Setting condition during gain/offset adjustment Normally : LED is off. During setting : LED blinks every 1 second. Setting completed : LED blinks for 3 seconds. Setting error : LED blinks every 0.5 seconds

2) Gain/offset channel selection key switch (For NP1AXH4-MR/NP1AX04-MR only)



- 0: Should be set for running.
- 1, 2, 3, 4: Channel numbers selected for gain/offset adjustment.
- 5 to 9: Not used.

3) Gain/offset selection key switch (For NP1AXH4-MR/NP1AX04-MR only)



- (Left) GAIN: Gain adjustment mode.
- (Center) SET: Gain/offset adjustment completion mode.
- (Right) OFFSET: Offset adjustment mode.


4) Detachable terminal block

This is a 20-pole (M3) detachable terminal block. For the terminal arrangement, refer to "5-2 Wiring of Analog Input Module."

2-8 Names and Functions

2-8-2 Analog output module (NP1AYH2-MR, NP1AY02-MR)


(1) Names

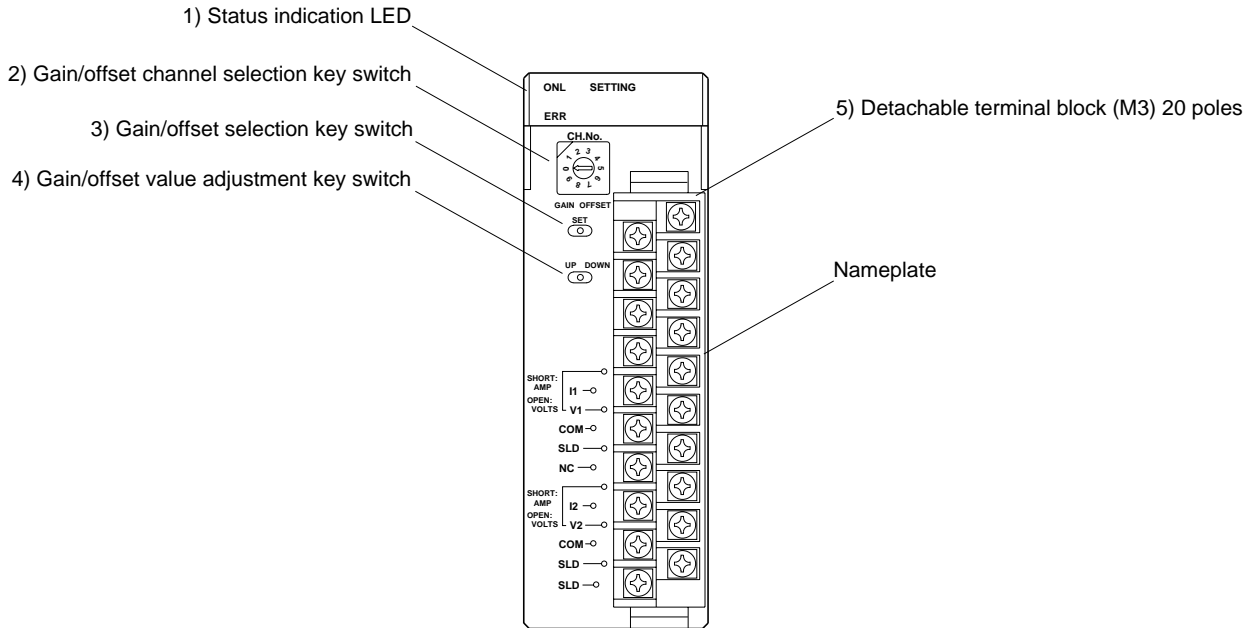

(2) Functions


1) Status indication LED

Indicates the status of the analog output module.



Symbol	Color	Status Description
ONL	Green	Lights on when local module is operating normally; blinks while connecting to SX bus.
ERR	Red	Lights on when local module is abnormal.
SETTING	Green	Setting condition during gain/offset adjustment Normally : LED is off. During setting : LED blinks every 1 second. Setting completed : LED blinks for 3 seconds. Setting error : LED blinks every 0.5 seconds

2) Gain/offset channel selection key switch



- 0: Should be set for running.
- 1, 2: Channel numbers selected for gain/offset adjustment.
- 3 to 9: Not used.

3) Gain/offset selection key switch

- GAIN OFFSET (Left) GAIN: Gain adjustment mode.
- SET (Center) SET: Gain/offset adjustment completion mode.
- OFFSET (Right) OFFSET: Offset adjustment mode.

4) Gain/offset value adjustment key switch

Used to adjust gain/offset values.



- (Left) UP, (Right) DOWN

5) Detachable terminal block

This is a 20-pole (M3) detachable terminal block. For the terminal arrangement, refer to "5-3 Wiring of Analog Output Module."


High-speed analog input module: NP1AXH4-MR

Standard analog input module: NP1AX04-MR

Standard analog input module: NP1AX08-MR

High-speed analog output module: NP1AYH2-MR

Standard analog output module: NP1AY02-MR

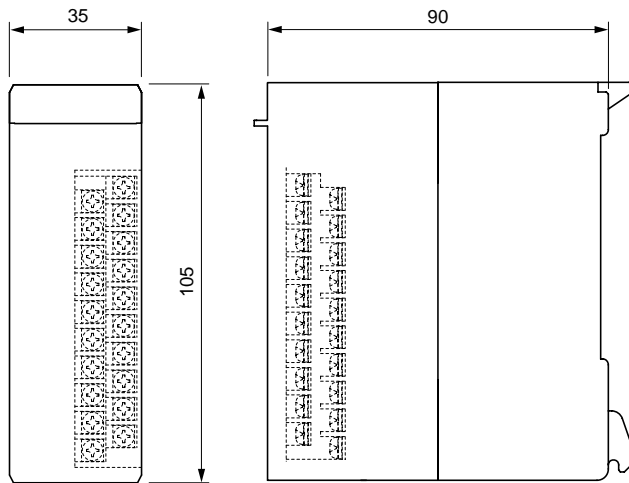

Section 3 System Configuration

	Page
3-1 Mounting on Base Board	3-1
3-1-1 Mounting position	3-1
3-1-2 Number of mountable modules	3-1


Section 3 System Configuration

3-1 Mounting on Base Board

3-1-1 Mounting position


The analog input/output modules are connected to the MICREX-SX Series SPH SX bus and I/O master module link. The mounting position of the modules on the base board is shown below.

<Base board without 6-slot base board>

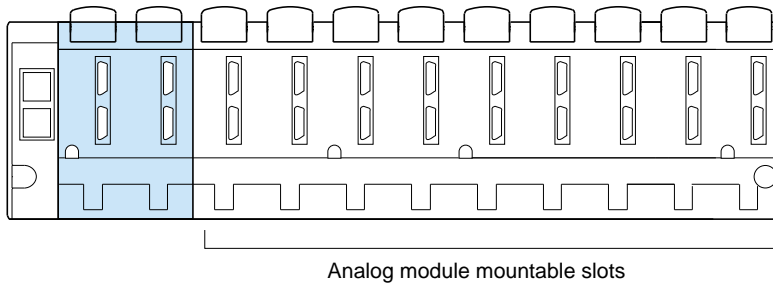


The modules can be mounted in any of the slots in the base board, except the two leftmost slots which are for the power module.

<6-slot base board>

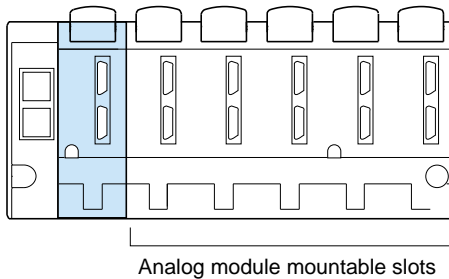

Note: NP1AX08-MR of analog 8-channel specification cannot be mounted on the baseboard for remote I/O.

Note: The I/O modules can also be mounted on the base board of a slave station of the T-link, OPCN-1, etc.

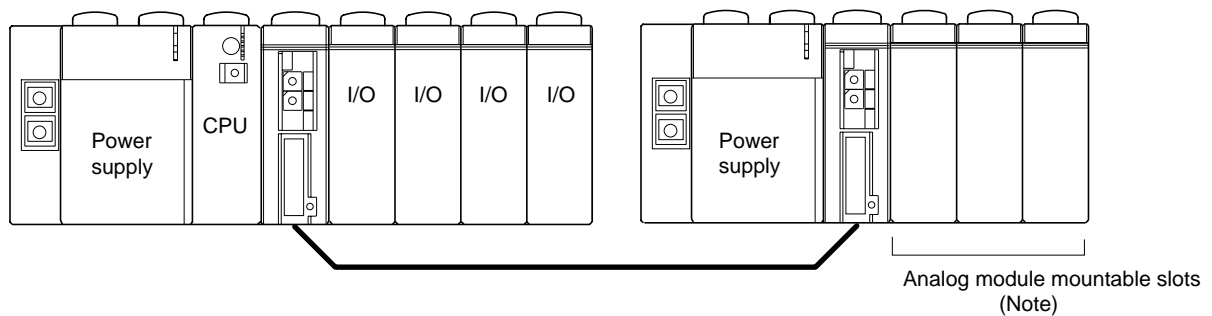

3-1-2 Number of mountable modules

It is possible to connect a maximum of 238 modules to the SX bus (a maximum of 254 modules in one configuration including the link of the I/O master) (due to hardware limitation).

It should be noted, however, that the maximum number of analog input/output modules that can actually be connected is limited by the number of words they occupy in the input/output areas (I/Q areas).

$$\text{For analog input module (4 channels)} \quad \frac{512 \text{ words}}{10 \text{ words}} \approx 51.2 \approx 51 \text{ modules}$$

$$\text{For analog input module (8 channels)} \quad \frac{512 \text{ words}}{18 \text{ words}} \approx 28.4 \approx 28 \text{ modules}$$

$$\text{For analog output module} \quad \frac{512 \text{ words}}{6 \text{ words}} \approx 85.3 \approx 85 \text{ modules}$$

Section 4 Software Interface

	Page
4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)	4-1
4-1-1 Memory assignment.....	4-1
(1) Digital output value	4-2
(2) Status	4-3
(3) Operation setting area	4-6
(4) Set value area	4-7
4-1-2 Operation setting procedure	4-9
4-1-3 Scaling data setting procedure	4-11
4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)	4-13
4-2-1 Memory assignment.....	4-13
(1) Status (offset addresses +0, +1)	4-13
(2) Operation setting area (offset address +2 for channel 1, offset address +3 for channel 2)	4-15
(3) Output value setting area	4-15
4-2-2 Operation setting procedure	4-17
4-2-3 Test output procedure	4-18
4-2-4 Scaling data setting procedure	4-19

Section 4 Software Interface

4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

For the analog input module, the following operations can be specified by an application program.

- Setting of analog input range (The analog input range is factory set to -10V to 10V. When any other range is used, be sure to set that range.)
- Conversion enable/disable
- Averaging process/sampling process
- Pre-alarming
- Scaling (For NP1AXH4-MR only)

4-1-1 Memory assignment

The analog input module (NP1AXH4-MR, NP1AX04-MR) occupies 10 words (8 words for input and 2 words for output) in the input/output areas.

		b15		b0	
Offset addresses	+0	Channel 1 digital output value			} AI module to CPU (8 words)
	+1	Channel 2 digital output value			
	+2	Channel 3 digital output value			
	+3	Channel 4 digital output value			
	+4	Channel 1 status (setting information, detection of broken wire, conversion status, etc.)			
	+5	Channel 2 status (setting information, detection of broken wire, conversion status, etc.)			
	+6	Channel 3 status (setting information, detection of broken wire, conversion status, etc.)			
	+7	Channel 4 status (setting information, detection of broken wire, conversion status, etc.)			
	+8	Operation			} CPU to AI module (2 words)
	+9	Set value			

The analog input module (NP1AX08-MR) occupies 18 words (16 words for input and 2 words for output) in the input/output areas.

		b15		b0	
Offset addresses	+0	Channel 1 digital output value			} AI module to CPU (16 words)
	+1	Channel 2 digital output value			
	+2	Channel 3 digital output value			
	+3	Channel 4 digital output value			
	+4	Channel 5 digital output value			
	+5	Channel 6 digital output value			
	+6	Channel 7 digital output value			
	+7	Channel 8 digital output value			
	+8	Channel 1 status (setting information, detection of broken wire, conversion status, etc.)			
	+9	Channel 2 status (setting information, detection of broken wire, conversion status, etc.)			
	+10	Channel 3 status (setting information, detection of broken wire, conversion status, etc.)			
	+11	Channel 4 status (setting information, detection of broken wire, conversion status, etc.)			
	+12	Channel 5 status (setting information, detection of broken wire, conversion status, etc.)			
	+13	Channel 6 status (setting information, detection of broken wire, conversion status, etc.)			
	+14	Channel 7 status (setting information, detection of broken wire, conversion status, etc.)			
	+15	Channel 8 status (setting information, detection of broken wire, conversion status, etc.)			
	+16	Operation			} CPU to AI module (2 words)
	+17	Set value			

4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

(1) Digital output value

The area in which to store an analog value converted to a digital value.

<NP1AXH4-MR, NP1AX04-MR>

Offset addresses	+0	Channel 1 output value (INT type)
	+1	Channel 2 output value (INT type)
	+2	Channel 3 output value (INT type)
	+3	Channel 4 output value (INT type)

<NP1AX08-MR>


Offset addresses	+0	Channel 1 output value (INT type)
	+1	Channel 2 output value (INT type)
	+2	Channel 3 output value (INT type)
	+3	Channel 4 output value (INT type)
	+4	Channel 5 output value (INT type)
	+5	Channel 6 output value (INT type)
	+6	Channel 7 output value (INT type)
	+7	Channel 8 output value (INT type)

4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)


(2) Status

Indicates detection of broken wire, gain/offset adjustment status, and detection of pre-alarm points.

<NP1AXH4-MR, NP1AX04-MR>

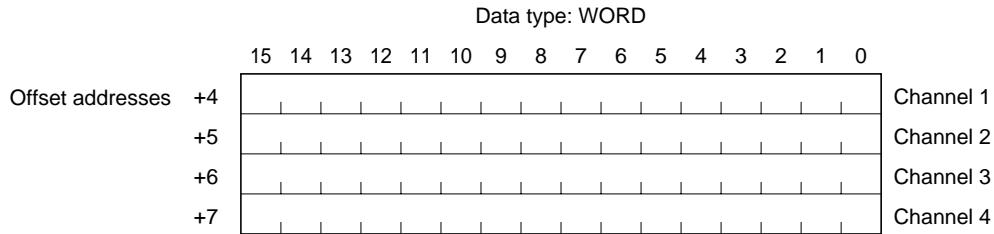

<NP1AX08-MR>

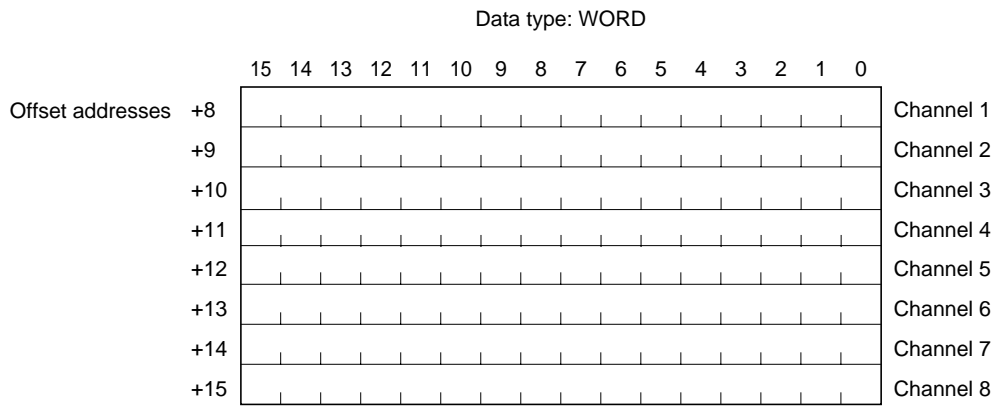

Bit	Status	Contents
0	Detection of broken wire	0: No broken wire detected, 1: Broken wire detected
1	Gain/offset adjustment status	0: Adjustment completed, 1: Adjusting (Unavailable for NP1AX08-MR)
2	Gain/offset adjustment error	0: No adjustment error, 1: Adjustment error (Unavailable for NP1AX08-MR)
3	Command completion	0: No command issued or command not completed, 1: Command completed
4	Over-range error	0: No error, 1: Error
5	Scaling data error	0: No error, 1: Error (Unused for NP1AX04-MR or NP1AX08-MR)
6		
7	Pre-alarm value	Point I
8	Pre-alarm value	Point H
9	Pre-alarm value	Point G
10	Pre-alarm value	Point F
11	Pre-alarm value	Point E
12	Pre-alarm value	Point D
13	Pre-alarm value	Point C
14	Pre-alarm value	Point B
15	Pre-alarm value	Point A


4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

<Detection of broken wire: bit 0>

A broken wire of the input signal line can be detected only when the analog input range is 4 to 20mA or 1 to 5V.

<Command completion: bit 3>

Each set data item is input to the AI module when the enable flag (bit 15 of offset address +8) is set. Upon completion of the input, the AI module sets the command completion flag. After confirming the command completion flag, the application program resets the enable flag.

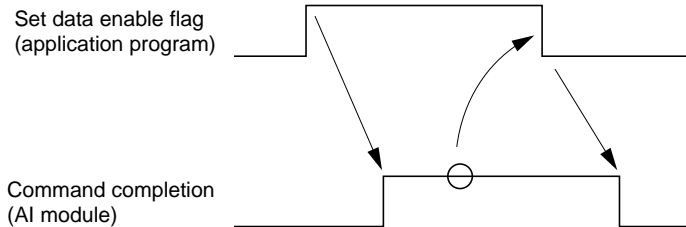

<Over-range error: bit 4>

This bit is set to "1" if an external voltage (current) input value exceeds the selected input range.

Example:

If 6V is input when the selected input range is 0 to 5V.

<Scaling data error: bit 5>

This bit is set ON when the set data for scaling is as follows:

- 1) When a value is input that is smaller than the minimum value of selected range or greater than the maximum value
- 2) When offset value and gain value are reversed in magnitude
- 3) If resolution differs between plus and minus sides with respect to offset when $\pm 5V$, $\pm 10V$ or $\pm 20mA$ range is selected

(How to reset error)

Error is reset when the setting of scaling is stopped (when bit 7 of the operating setting range is set OFF). However, because the previously set scaling data is stored, error is finally reset when the content of above 1) to 3) is modified.

<Pre-alarm value: bit 7 to 15>


- When the pre-alarm function has been set in the operation area, it is possible to detect pre-alarm points A through I.
- The pre-alarm function facilitates the processor to check the output value if specific input data changes. By using this function for constant monitoring, it is possible to simplify application programs since the need for data comparison by an application program is eliminated.
- The AI module compares an analog input value with the previous analog input value in each sampling period to check whether analog input values are increasing or decreasing and the level of each set point, and sets only one of the points A-I to "1" (all the other points set to "0") to detect pre-alarm information. When the scaling function is performed, the pre-alarm function is enabled after the scaling function.

4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

Pre-alarm point on/off conditions

Point	Condition for on	Condition for off
A	An increasing analog input value coincides with the high-limit pre-alarm value of the selected input range.	An analog input value coincides with the high-limit of the selected input range or reaches a peak.
B	An increasing analog input value coincides with the high-limit value of the selected input range.	An increasing analog input value reaches a peak.
C	An increasing analog input value exceeds the high-limit value of the selected input range and reaches a peak.	An analog input value decreases below the peak and coincides with the high-limit value of the selected input range.
D	A decreasing analog input value coincides with the high-limit value of the selected input range.	A decreasing analog input value coincides with the high-limit pre-alarm value of the selected input range.
E	An analog input value is below the gain pre-alarm value and above the low-limit pre-alarm value.	The condition for "on" shown at left has disappeared.
F	A decreasing analog input value coincides with the low-limit pre-alarm value.	An analog input value coincides with the lower-limit value or reaches a peak.
G	A decreasing analog input value coincides with the lower-limit value.	A decreasing analog input value reaches a bottom.
H	An analog input value decreases below the low-limit value and reaches a bottom.	An analog input value exceeds a peak and coincides with the low-limit value.
I	An analog input value is increasing in the range from low-limit value and low-limit pre-alarm value.	An increasing analog input value coincides with the low-limit pre-alarm value


Relationship between A-I points of pre-alarm value and analog input value

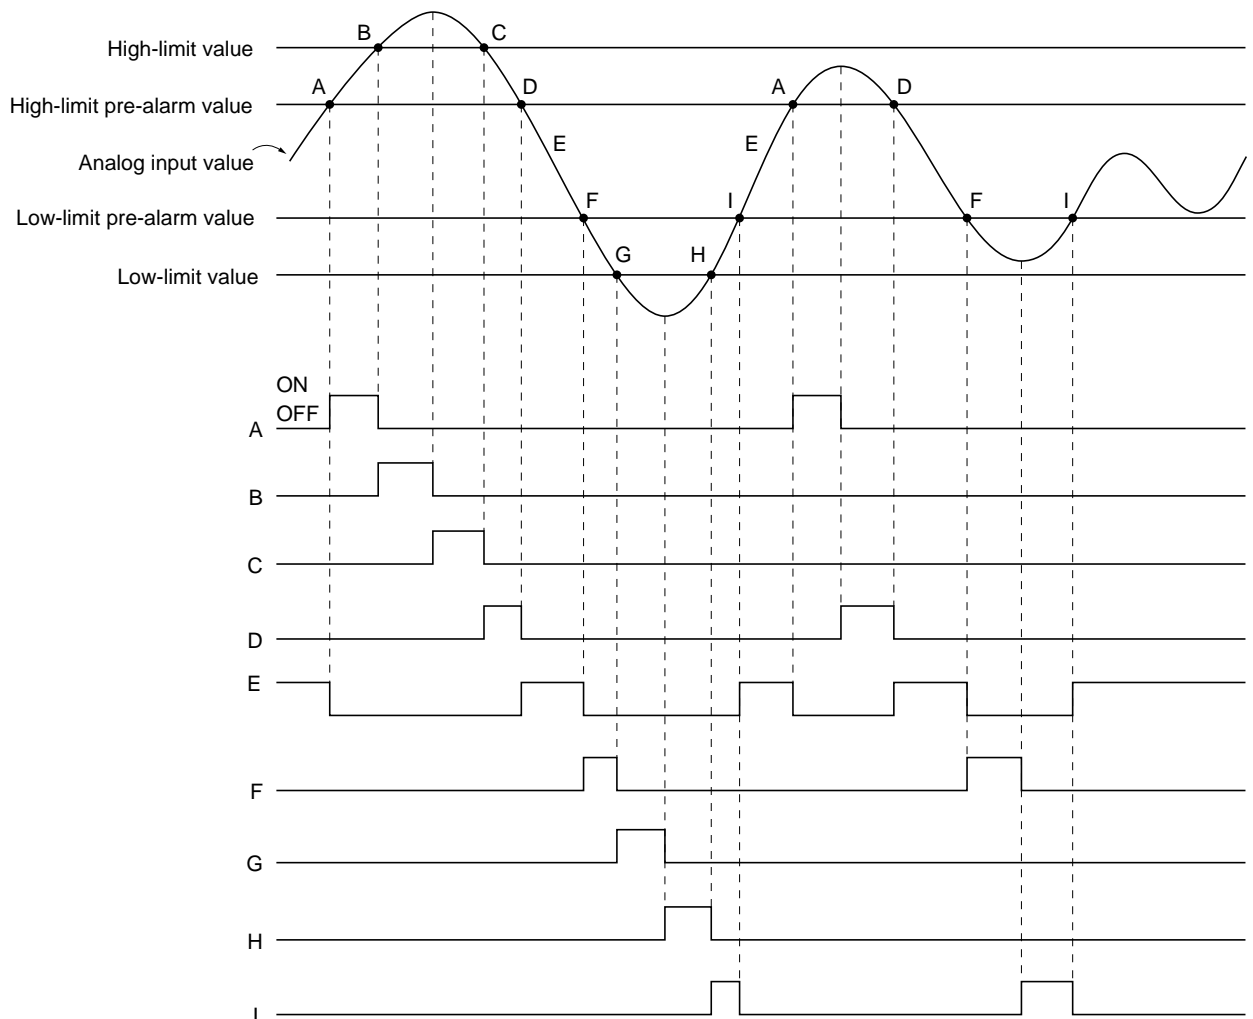

4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

(3) Operation setting area

For each channel of the analog input module, set the desired operations by an application program.

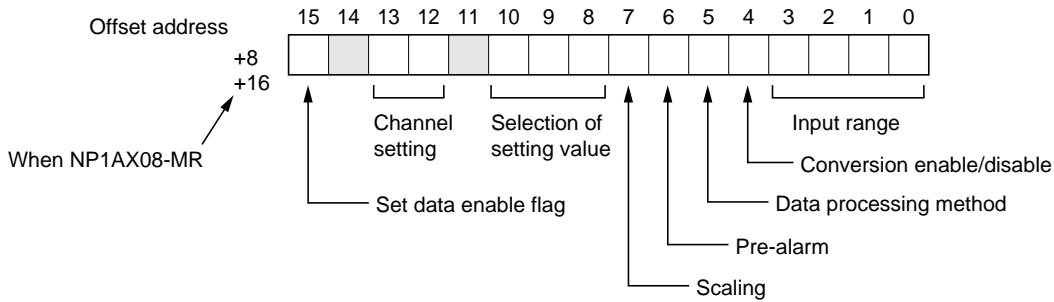

Bit	Operation mode	Contents	
0	Setting of input range	0000: 0 to 10V	
1		0001: 0 to 5V	
2		0010: 1 to 5V	
3		0011: ± 5V	
		0100: ± 10V	
		0101: 0 to 20mA	
		0110: 4 to 20mA	
		0111: ± 20mA	
		1000 to 1111: Reserved	
4	Conversion enable/disable	0: Conversion enabled, 1: Conversion disabled	
5	Setting of data processing method	0: Sampling process, 1: Averaging process	
6	Setting of pre-alarm	0: Not set, 1: Set	
7	Setting of scaling	0: Not set, 1: Set (Unused for NP1AX04-MR or NP1AX08-MR)	
8	Selection of setting value	000: Not selected	
9		001: Offset scaling data (Unused for NP1AX04-MR or NP1AX08-MR)	
10		010: Gain scaling data (Unused for NP1AX04-MR or NP1AX08-MR)	
		011: Number of times of averaging	
		100: Pre-alarm value	
	101: Offset value	} Disabled for NP1AX08-MR. If set, conversion characteristic may be changed.	
	110: Gain value		
	111: Gain/offset decision		
11	Not used		
12	Setting of channel	000: Channel 1	100: Channel 5
13		001: Channel 2	101: Channel 6
		010: Channel 3	110: Channel 7
		011: Channel 4	111: Channel 8
14	Not used		
15	Set data enable flag	0: Not enabled, 1: Enabled	


Note: The setting of module operation, etc. is stored in the module internal EEPROM. Therefore, each time a setting program is executed (when the set data enable flag is set ON/OFF), it is written in the EEPROM. Be careful not to exceed the warranted write operation cycles of the EEPROM (100,000 cycles)

4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

(4) Set value area

<Scaling data>

When the setting of scaling has been specified in the operation area, it is possible to set scaling by setting 1) scaling data of offset-value and 2) scaling data of gain-value in the set value area.

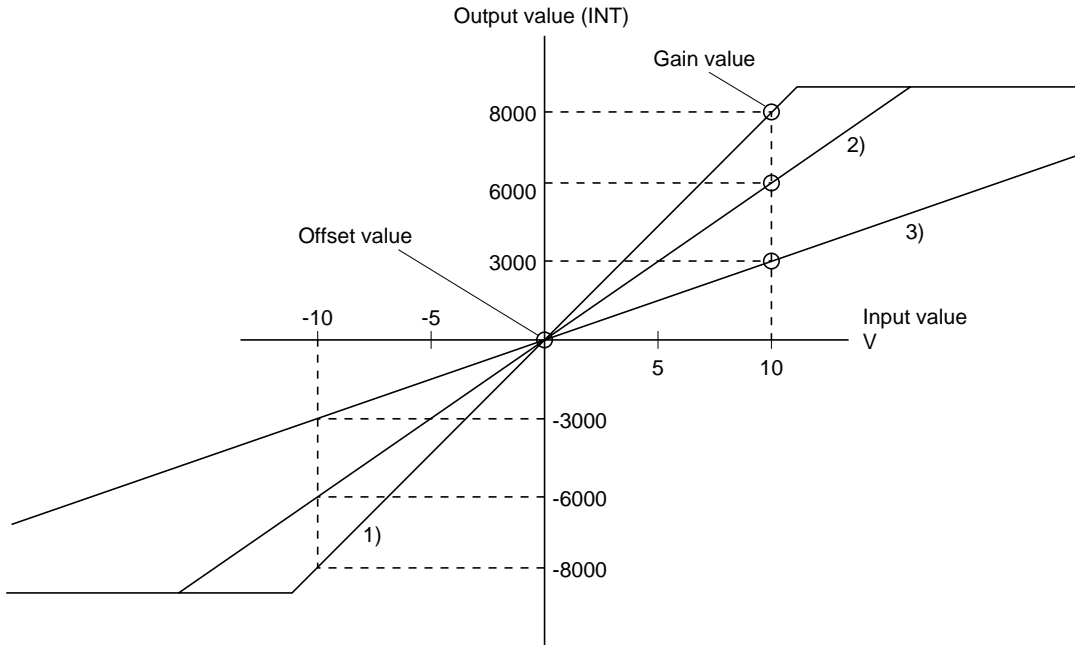

- 1) $\pm 10V$: ± 8000 before scaling (default value)
- 2) $\pm 10V$: When scaled to ± 6000
- 3) $\pm 10V$: When scaled to ± 3000

Note: When scaling is performed, the overall accuracy depends on the scaling range.

1) Scaling data of offset-value


Offset address +9

2) Scaling data of gain-value

Offset address +9

4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

<Setting of number of times of averaging>

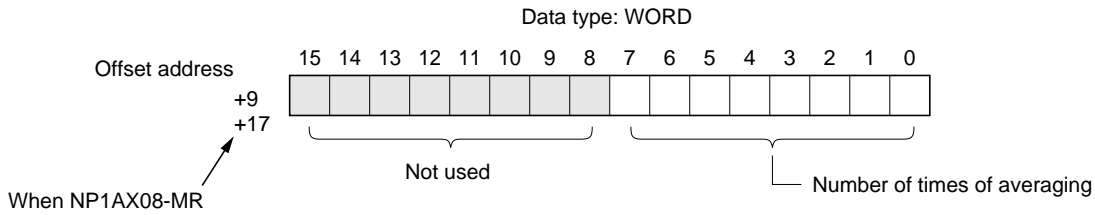


- Setting range for the number of times of averaging:
 - NP1AXH4-MR or NP1AX04-MR 1 to 128 cycles (01h to 80h)
 - NP1AX08-MR 1 to 64 cycles (01h to 40h)
 However, sampling is performed if 2 or smaller value is set. If a value is set that is greater than the maximum value, the corresponding maximum value is selected for the operation.
- The averaging process time (per channel) can roughly be calculated by the following equation.

$$\text{Averaging process time(s)} = 75\mu\text{s} + [(n - 3) \times 3.4\mu\text{s}]$$
 where, n denotes the number of times of averaging (n = 3 or more).

Note: When averaging is performed, averaging process time (s) is added to sampling period.

<Setting of pre-alarm function>

With this function, it is possible to issue a pre-alarm before 45% of the high-limit or low-limit value is reached. Set 30%, 35%, 40%, or 45% for each of the channels.

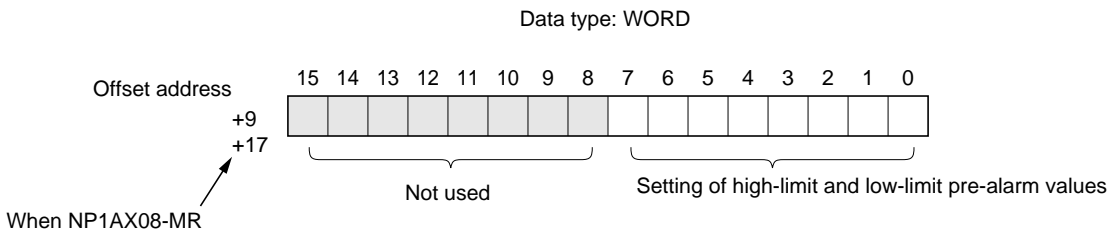

Bit	Pre-alarm value	Set value
0	High-limit value	-30%
1		-35%
2		-40%
3		-45%
4	Low-limit value	+30%
5		+35%
6		+40%
7		+45%

Select one bit.

Select one bit.

Example

When the input range, high-limit value, and low-limit value are set to 0 to 10V, -30%, and +40%, respectively, the pre-alarm values become as follows.

- High-limit pre-alarm value $10\text{V} - (10\text{V} \times 30\%) = 7\text{V}$
- Low-limit pre-alarm value $0\text{V} + (10\text{V} \times 40\%) = 4\text{V}$

4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)


4-1-2 Operation setting procedure

Operation of the analog input module (NP1AXH4-MR or NP1AX04-MR) is set using the registers of offset addresses + 8 and + 9 (offset addresses + 16 and + 17 for NP1AX08-MR).

<Setting procedure>


To set $\pm 5V$ range, averaging (50 cycles) and pre-alarm 30% (for both high- and low-limit values) for channel 3 of NP1AXH4-MR (supposing that SX station number of the module is "10")

- 1) Set the channel (channel 3), selection of setting value (not selected), pre-alarm (set), data processing (averaging), conversion enable/disable (enable), input range ($\pm 5V$), and set data enable flag (enabled), respectively, in the operation setting area.

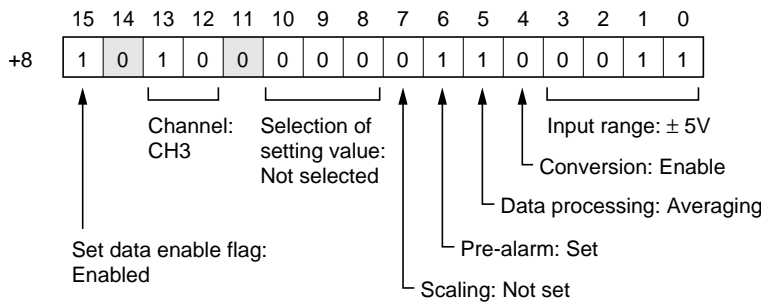


- 2) Confirm that the command completion flag is ON, then reset the set data enable flag (1 to 0). The command completion flag for channel 3 is the third bit of channel 3 status (offset address +06). When the set data enable flag is reset, the command completion flag of channel 3 turns OFF. Confirm that the command completion flag has turned OFF, then proceed to the next step.

- 3) Set the number of times of averaging. Set 50 (32h) in the value setting area and set the set value selection to No. of times of averaging.


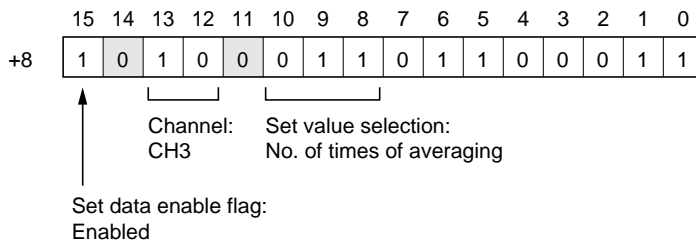


- 4) Confirm that the command completion flag is ON, then reset the set data enable flag (1 to 0). When the set data enable flag is reset, the command completion flag of channel 3 turns OFF. Confirm that the command completion flag has turned OFF, then proceed to the next step.

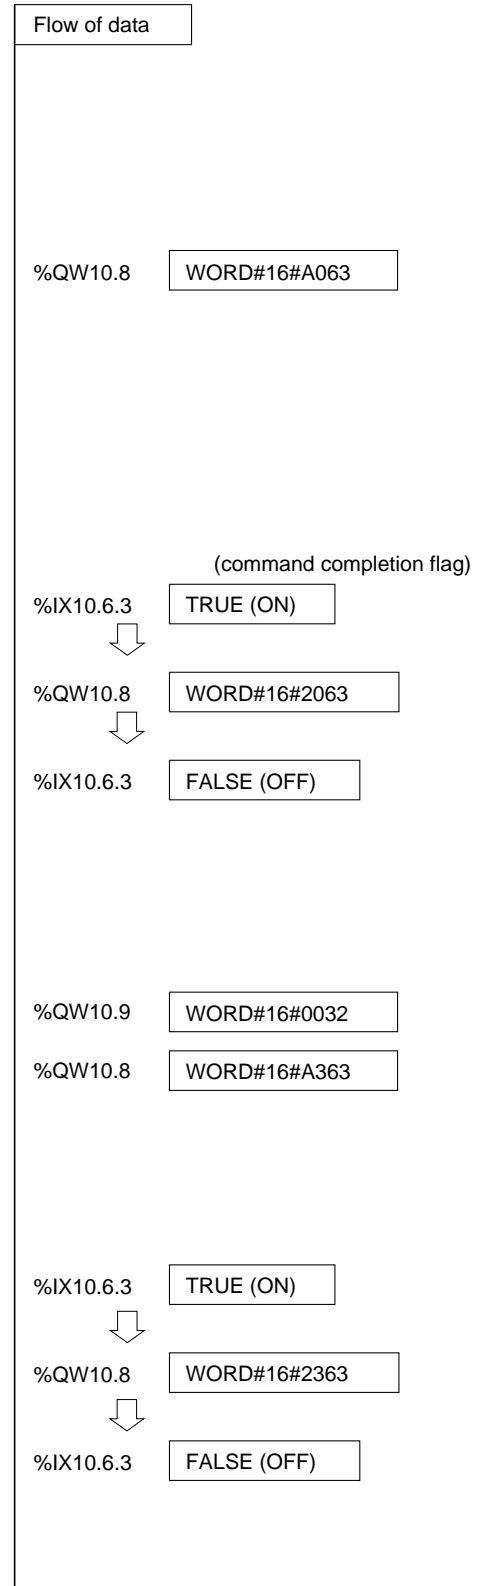

4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

5) Set the pre-alarm value (30%). Set 30% in the value setting area and set the set value selection to Pre-alarm value.

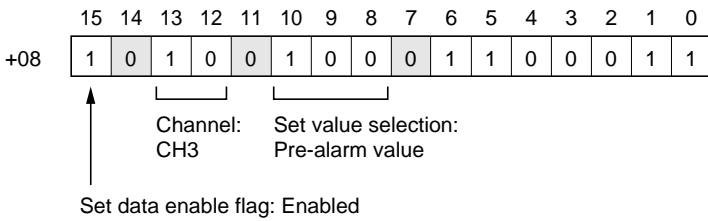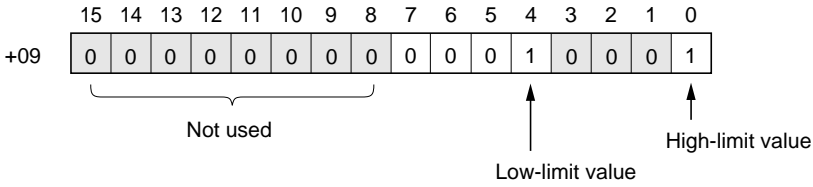

6) Confirm that the command completion flag is ON, then reset the set data enable flag (1 to 0). When the set data enable flag is reset, the command completion flag turns OFF.

Completed

%QW10.9 WORD#16#0011

%QW10.8 WORD#16#A463

%IX10.6.3 TRUE (ON)



%QW10.8 WORD#16#2463



%IX10.6.3 FALSE (OFF)

4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)


4-1-3 Scaling data setting procedure

With the Analog input module (NP1AXH4-MR), it is possible to change the gradient of A/D conversion by scaling.

<Setting procedure>


To scale $\pm 10V: \pm 8000$ to $\pm 10V: 4500$ for channel 2 (SX bus station number of the module assumed to be "10"):

- 1) Set "Conversion: Disable" for the channel to be scaled.

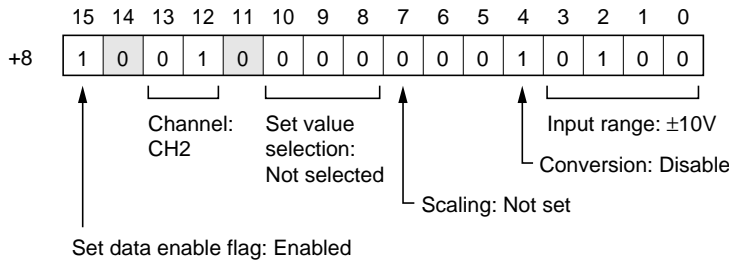


- 2) Confirm that the command completion flag is ON, then reset the set data enable flag. When the set data enable flag is reset, the command completion flag turns OFF. Confirm that the command completion flag has turned OFF, then proceed to the next step.

- 3) Set the offset-value scaling data in the value setting area.




- 4) Set the channel (CH2), set value selection (offset-value scaling data), input range ($\pm 10V$), and set data enable flag (enabled) in the operation setting area.

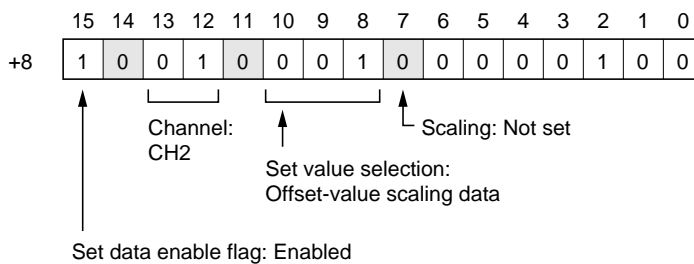

- 5) Confirm that the command completion flag is ON, then reset the set data enable flag. When the set data enable flag is reset, the command completion flag turns OFF. Confirm that the command completion flag has turned OFF, then proceed to the next step.

In this step, the offset-value scaling data is input to the Analog input module (NP1AXH4-MR).

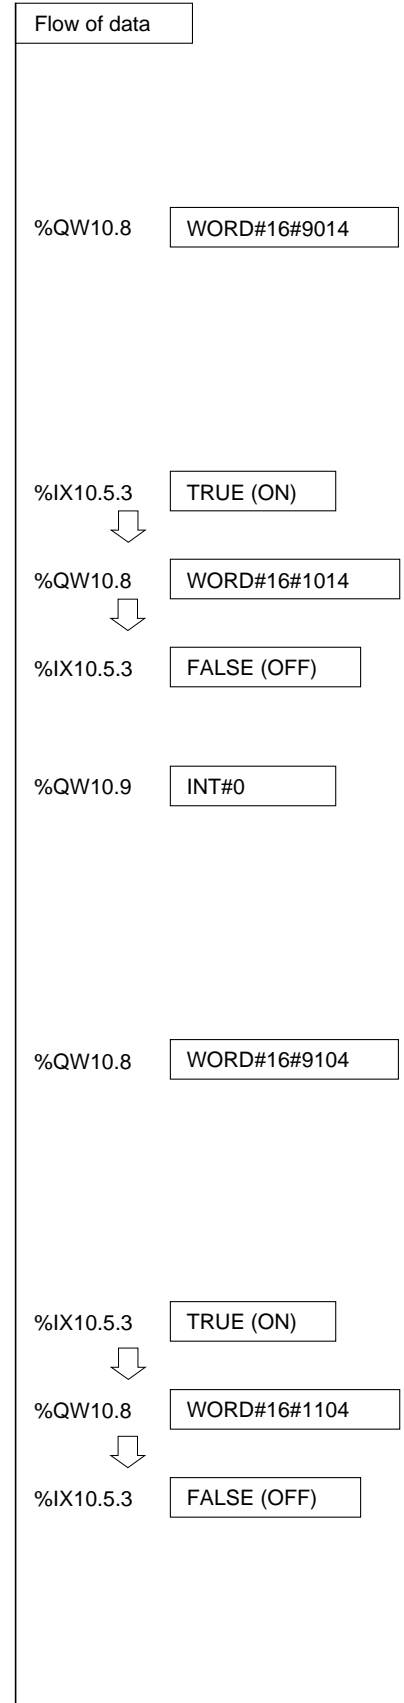


4-1 Analog Input Module (NP1AXH4-MR, NP1AX04-MR, NP1AX08-MR)

6) Set the gain-value scaling data in the value setting area.

+9

%QW10.9

7) Set the channel (CH2), set value selection (gain-value scaling data), input range ($\pm 10V$), and set data enable flag (enabled) in the operation setting area.

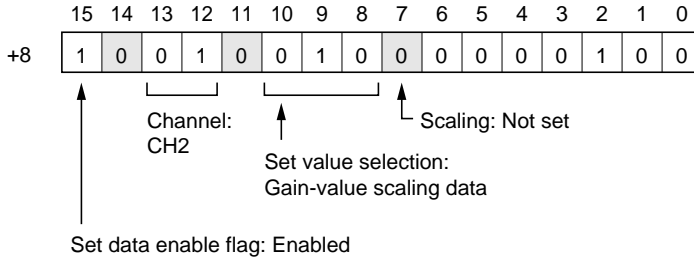

%QW10.8

8) Confirm that the command completion flag is ON, then reset the set data enable flag. When the set data enable flag is reset, the command completion flag turns OFF.


In this step, the gain-value scaling data is input to the Analog input module (NP1AXH4-MR).

%IX10.5.3

%QW10.8

%IX10.5.3

9) The scaling operation starts. Set the set value selection (not selected), scaling (set), and set data enable flag (enabled) in the operation setting area.

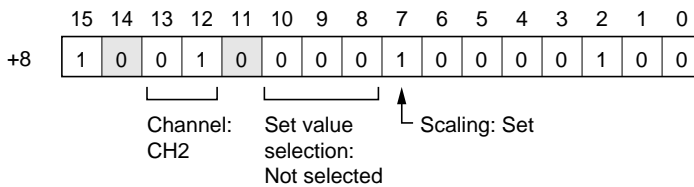

%QW10.8

10) Confirm that the command completion flag is ON, then reset the set data enable flag. When the set data enable flag is reset, the command completion flag turns OFF.

%IX10.5.3

%QW10.8

%IX10.5.3


4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)

For the analog output module, specify the following operations by an application program.

- Setting of analog output range (The output range is factory set to 1 to 5V. When any other output range is used, be sure to specify that range.)
- Output enable/disable
- Negative value output enable/disable
- Test output
- Scaling (NP1AYH2-MR only)


4-2-1 Memory assignment

The analog output module occupies 6 words (2 for input and 4 for output) in the input/output areas.

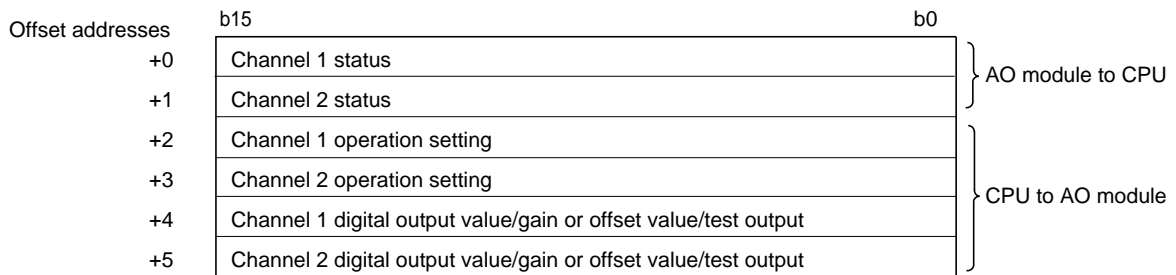

(1) Status (offset addresses +0, +1)

Data type: WORD




Bit	Status	Contents
0	Status of gain/offset adjustment	0: Adjustment completed, 1: Adjustment being made
1	Gain/offset adjustment error	0: No adjustment error, 1: Adjustment error
2	Command completion	0: No command or command not completed, 1: Completed
3	Not used	
4	Over-range error	0: No over-range error, 1: Over-range error
5	Scaling error	0: No scaling error, 1: Scaling error (Unavailable for NP1AY02-MR)
6	Not used	
:		
:		
15		

4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)

<Command completion>

Each set data item is input to the analog output module when the enable flag (bit 15 of offset address +2 for channel 1, bit 15 of offset address +3 for channel 2) is set. When the input of data is completed, the command completion flag is set by the analog output module. The user should reset the enable flag by the application program after confirming that the command completion flag has been set.

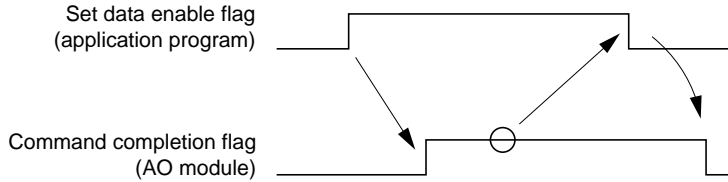

<Over-range error>

If a digital value which is output from the application program exceeds the selected range, this status bit is set to 1.


<Scaling data error>

If the set scaling data exceeds the selected range, this status bit is set to 1.

4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)

(2) Operation setting area (offset address +2 for channel 1, offset address +3 for channel 2)

For each channel of the analog output module, set the following operations by an application program.

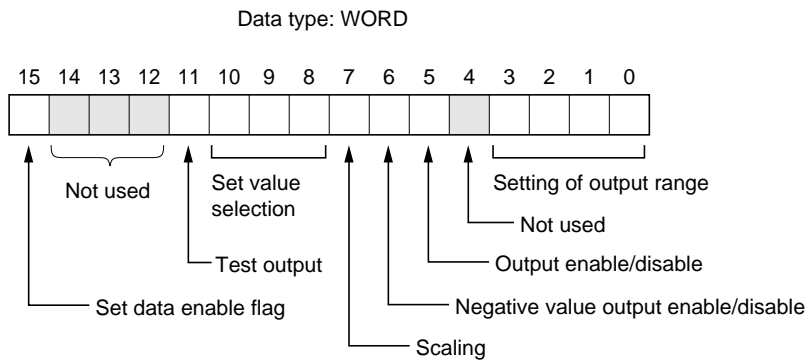

Bit	Operation mode	Contents
0	Setting of output range	0000: 0 to 10V
1		0001: 0 to 5V
2		0010: 1 to 5V
3		0011: ± 5V
		0100: ± 10V
		0101: 0 to 20mA
		0110: 4 to 20mA
		0111: 15 Not used
		:
		:
		1111: 15 Not used
4	Not used	
5	Output enable/disable	0: Output enable, 1: Output disable
6	Negative value output enable/disable	0: Enable, 1: Disable
7	Scaling	0: Not set, 1: Set (Unavailable for NP1AY02-MR)
8	Selection of setting value	000: Not selected
9		001: Offset scaling data (Unavailable for NP1AY02-MR)
10		010: Gain scaling data (Unavailable for NP1AY02-MR)
		011: Not used
		111: Not used
		:
		:
11	Test output	0: Output disable, 1: Output enable
12	Not used	
13		
14		
15	Set data enable flag	0: Not enabled, 1: Enabled

(3) Output value setting area

Analog output value(D/A converted value), gain value, offset value, and test output value are set in this area.

<Analog output value setting area> (offset addresses +4, +5)


Offset address

+4	Channel 1 output value (INT type)
+5	Channel 2 output value (INT type)

4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)

<Test output value setting area> (offset addresses +4, +5)

- By turning on any one of bits 0 through 4, it is possible to obtain a % output value for the full scale.

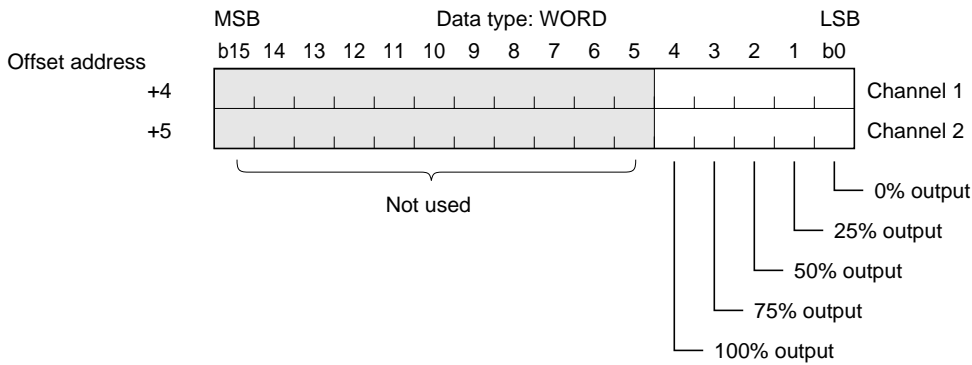

Note: If multiple bits are set ON at the same time, the output becomes 0%.


<Examples of output values>

Range	Output	0%	25%	50%	75%	100%
0 to 10V		0V	2.5V	5V	7.5V	10V
± 10V		- 10V	- 5V	0V	5V	10V

<Scaling data>

When "Scaling: Set" has been specified in the setting of operations, it is possible to perform scaling by setting 1) offset-value scaling data and 2) gain-value scaling data in the output value setting area.

Example of scaling

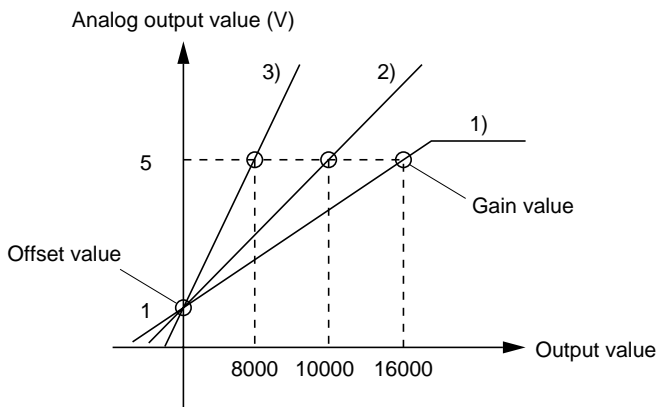

- 1) 1 to 5V : 16000 before scaling (default value)
- 2) 1 to 5V : When scaled to 10000
- 3) 1 to 5V : When scaled to 8000

• Offset-value scaling data

Offset address	
+4	Channel 1 data (INT type)
+5	Channel 2 data (INT type)

4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)

• Gain-value scaling data

Offset address	
+4	Channel 1 data (INT type)
+5	Channel 2 data (INT type)


4-2-2 Operation setting procedure

To set operations of the analog output module (NP1AYH2-MR, NP1AY02-MR), use the registers of offset address +2 (for channel 1) and +3 (for channel 2).

<Setting procedure>

To output channel 1 data in the $\pm 10V$ range (SX bus station number of the module assumed to be "11"):


- 1) Set the output range ($\pm 10V$), output enable/disable (enable), negative value output enable/disable (enable), test output enable/disable (disable), selection of setting value (not selected), and set data enable flag (enabled) in the operation setting area for channel 1.

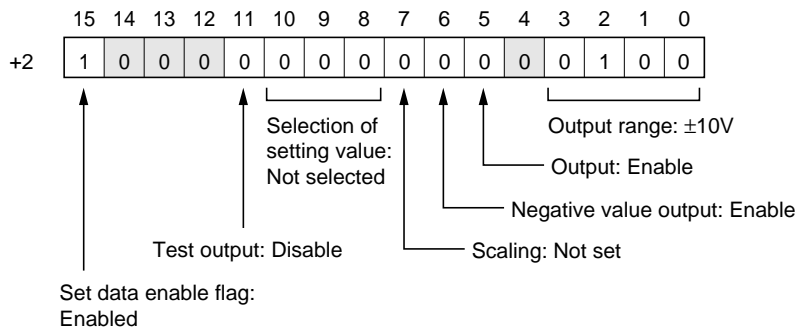

: Bits not used

- 2) Confirm that the command completion flag is ON, then reset the set data enable flag. When the set data enable flag is reset, the command completion flag for channel 1 turns OFF.

Completed

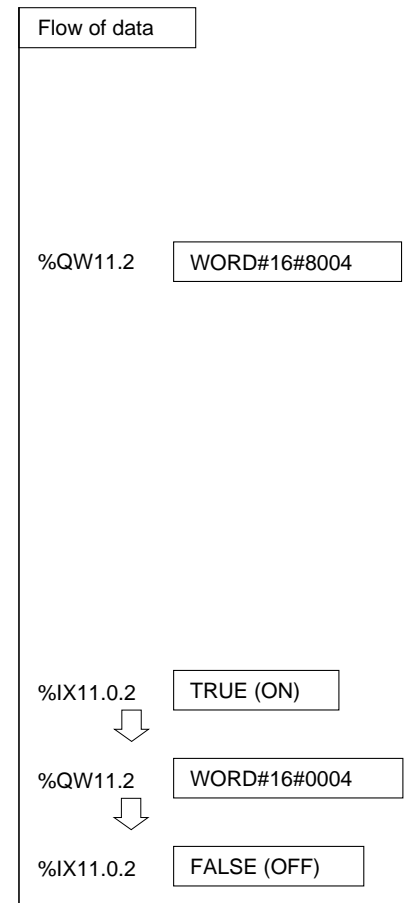

4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)


4-2-3 Test output procedure

With the analog output module (NP1AYH2-MR, NP1AY02-MR), it is possible to perform test output using the operation setting area (offset addresses +2, +3) and the output value setting area (offset addresses +4, +5).

<Test output procedure>


To test-output channel 0 data in the 4 to 20mA range at 50% output (12mA) (SX bus station number of the module assumed to be "11"):

- 1) Set the output range (4 to 20mA), output enable/disable (disable), negative value output enable/disable (disable), test output enable/disable (disable), selection of setting value (not selected), and set data enable flag (enabled) in the operation setting area for channel 1.


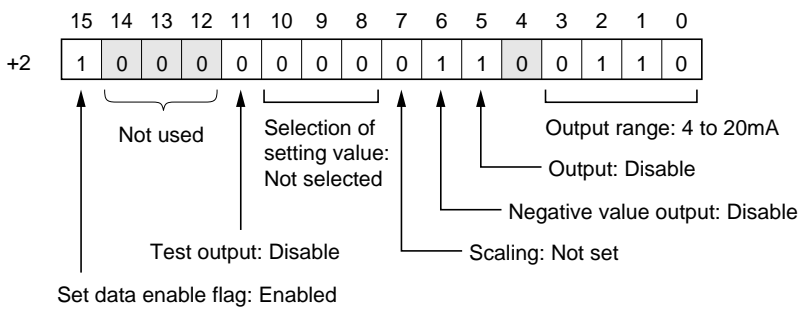


- 2) The command completion flag turns ON and the set test output value is output from the module output terminal. Reset the set data enable flag to turn the command completion flag OFF.

- 3) Set 50% output (bit 2 "ON") in the output value setting area (offset address +4 for channel 1).

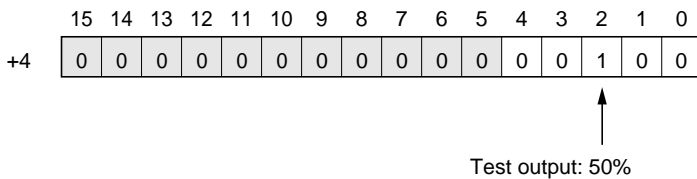


- 4) Set the output range (4 to 20mA), output enable/disable (enable), negative value output enable/disable (enable), test output enable/disable (enable), selection of setting value (not selected), and set data enable flag (enabled) in the operation setting area for channel 1.

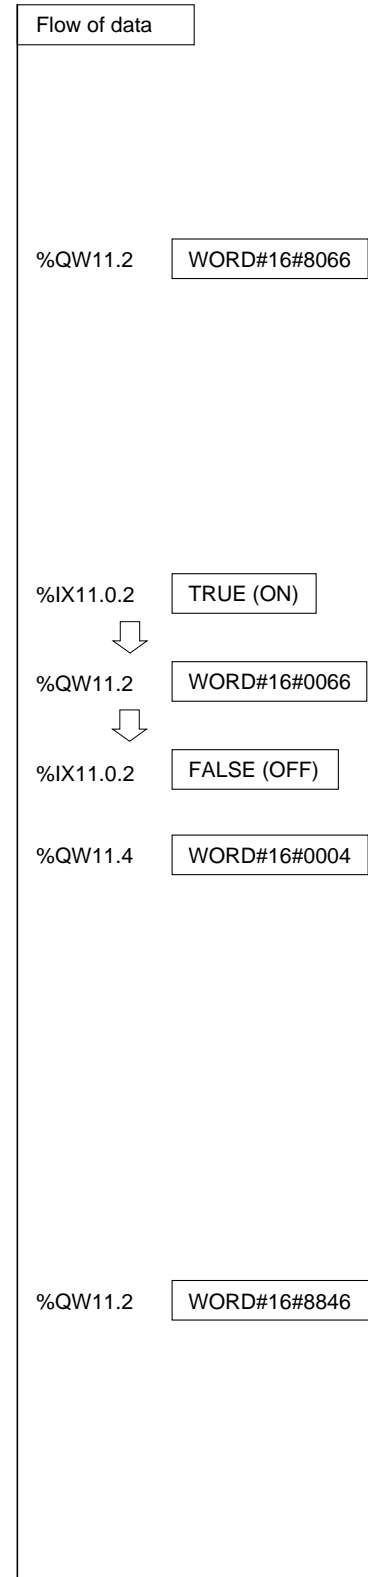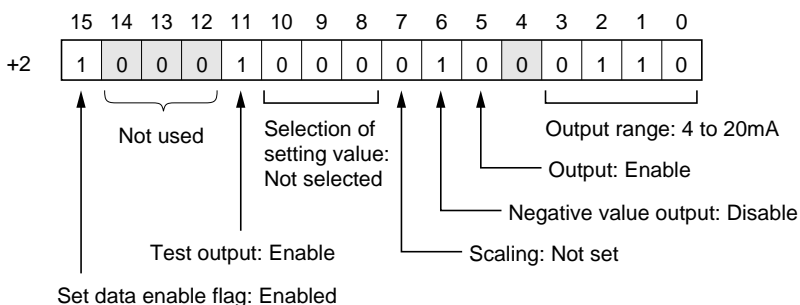


4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)

5) When the command completion flag is set ON, the set data enable flag is reset; when the command completion flag is set OFF, the set test output value is output from the output terminal of the module.

6) To stop the test output, set the test output (disable) and the set data enable flag (enabled) in the operation setting area for channel 1.

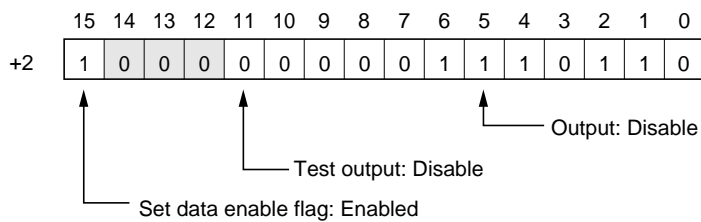

7) The command completion flag turns ON and the test output stops. Reset the set data enable flag to turn the command completion flag OFF.

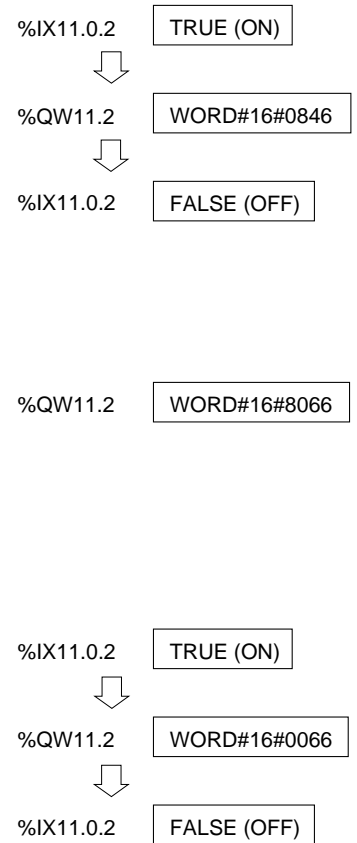


4-2-4 Scaling data setting procedure

With the analog output module (NP1AYH2-MR), it is possible to change the gradient of A/D conversion by scaling.


<Setting procedure>

To scale 4 to 20mA:0 to 16000 for channel 2 to 4 to 20mA:0 to 10000 (SX bus station number of the module assumed to be "11"):

1) Set the test output (disable), selection of setting value (offset-value scaling data), negative value output (disable), output (disable), output range (4 to 20mA), and set data enable flag (enabled) in the operation setting area.

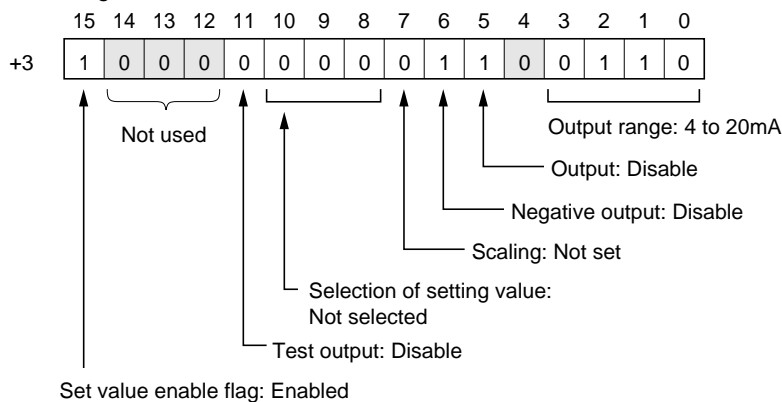

2) Confirm that the command completion flag is ON, then reset the set value enable flag. When the set data enable flag is reset, the command completion flag turns OFF. After confirming that the command completion flag has turned OFF, proceed to the next step.

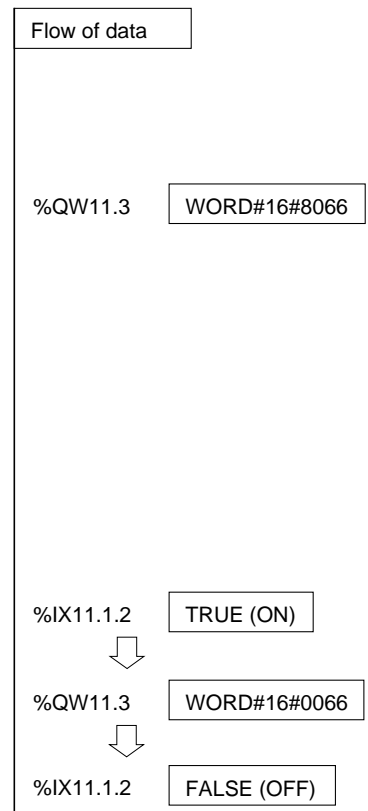


4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)

3) Set the gain-value scaling data in the value setting area.

+5

%QW11.5

4) Set test output (disable), selection of setting value (offset-value scaling data), negative value output (disable), output (disable), output range (4 to 20mA), and set data enable flag (enabled) in the operation setting area.

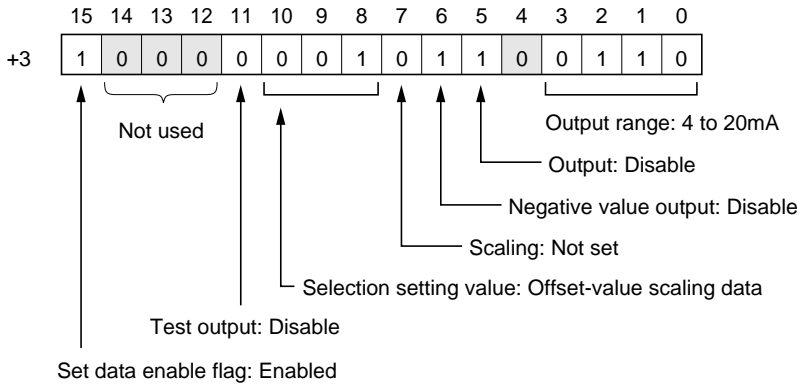

%QW11.3

5) Confirm that the command completion flag is ON, then reset the set value enable flag. When the set data enable flag is reset, the command completion flag turns OFF. Confirm that the command completion flag has turned OFF, then proceed to the next step.

%IX11.1.2



%QW11.3



%IX11.1.2


In this step, the offset-value scaling data is input to the module (NP1AYH2-MR).

6) Set the gain-value scaling data in the value setting area.

+5

%QW11.5

7) Set test output (disable), selection of setting value (gain-value scaling data), negative value output (disable), output (disable), output range (4 to 20mA), and set data enable flag (enabled) in the operation setting area.

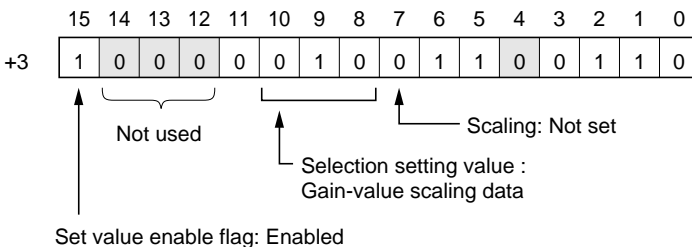

%QW11.3

8) Confirm that the command completion flag is ON, then reset the set value enable flag. When the set data enable flag is reset, the command completion flag turns OFF.

%IX11.1.2



%QW11.3



%IX11.1.2

In this step, the gain-value scaling data is input to the module (NP1AYH2-MR).

4-2 Analog Output Module (NP1AYH2-MR, NP1AY02-MR)

- 9) Before scaling is started, input a data that makes the output zero, from the output data that are scaled in the setting area. (In order to prevent erroneous output)

+5

%QW11.5

- 10) The scaling starts. Set selection of setting value (not selected), scaling (set), and set data enable flag (enabled) in the operation setting area.

	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
+3	1	0	0	0	0	0	0	0	1	1	0	0	0	1	1	0

Selection of setting value: Not selected (bits 10-15)
 Scaling: Set (bits 7-8)
 Output: Enable (bits 5-6)

%QW11.3

- 11) Confirm that the command completion flag is ON, then reset the set data enable flag. When the set data enable flag is reset, the command completion flag turns OFF.

%IX11.1.2



%QW11.3



%IX11.1.2

Note on multi-CPU system

When the analog output module is used on a multi-CPU system, use only one CPU to set operation modes (range setting, scaling, etc.) for the same channel.
 Do not use more than one CPU to set operation modes for the same channel.

Section 5 Wiring

	Page
5-1 Wiring Precautions	5-1
5-2 Wiring of Analog Input Module	5-2
5-2-1 Terminal arrangement (NP1AXH4-MR, NP1AX04-MR)	5-2
5-2-2 Wiring example	5-2
5-3 Wiring of Analog Input Module (NP1AX08-MR)	5-3
5-3-1 Terminal arrangement	5-3
5-3-2 Wiring example	5-3
5-4 Wiring of Analog Output Module	5-4
5-4-1 Terminal arrangement (NP1AYH2-MR, NP1AY02-MR)	5-4
5-4-2 Wiring example	5-4

Section 5 Wiring

5-1 Wiring Precautions


- 1) Do not remove the module's attached dust-cover seals during wiring. After wiring, be sure to remove the dust-cover seals.
- 2) Perform the following to the terminals that are not used.
 Input module Short-circuit terminals V.I and COM.
 Output module Keep the terminals open.
- 3) Isolate the module power supply line and input/output lines from high-voltage lines and power lines. Also, avoid wiring them in parallel with each other.
- 4) Ground the shielding wires or the shields of shielding cables at a single point on the PC side. Depending on the condition and type of external noise, however, external grounding may be better.
 When grounding the shielding wire on the outside, leave the module SLD terminal open.
- 5) It is recommended that a shielded twisted pair wire be used to wire the module.
- 6) In wiring the module, be sure to use a suitable wire and crimp terminals.
 The applicable wire sizes and crimp terminals are shown below.

Maker	Form	Type	Cable size	
			AWG #	mm ²
AMP	Round terminals	36467	22 to 18	0.3 to 0.8mm ²
		34104		
		34105		
Nichifu	Round terminals	0.3-3	24 to 20	0.2 to 0.5mm ²
		0.3-3N		
		1.25-3	22 to 16	0.3 to 1.3mm ²
		1.25-3N		
		1.25-3S		
		1.25-3.5N		
		1.25-3.5S		
	2-3N	16 to 14	1.3 to 2.0mm ²	
	Angle edge terminals	0.3Y-3	24 to 20	0.2 to 0.5mm ²
		1.25Y-3	22 to 16	0.3 to 1.3mm ²
		1.25Y-3N		
		1.25Y-3S		
		1.25Y-3.5		
		2Y-3	16 to 14	1.3 to 2.0mm ²
2Y-3.5S				
AT1-10	22 to 16	0.3 to 1.3mm ²		
AT2-10	16 to 14	1.3 to 2.0mm ²		
JST	Round terminals	SRA-20-3.2	22 to 18	0.3 to 0.8mm ²
		SRA-20T-3.2		
NTK	Round terminals	0.4-3	26 to 22	0.2 to 0.3mm ²
		1.25-3	22 to 16	0.3 to 1.3mm ²
	VR1.25-3			
	VD1.25-3			
	Angle edge terminals	VD2-3S	16 to 14	1.3 to 2.0mm ²

- 7) For any of the above crimp terminals, use a tightening torque of 0.5 to 0.7N·m.

5-2 Wiring of Analog Input Module


5-2-1 Terminal arrangement (NP1AXH4-MR, NP1AX04-MR)

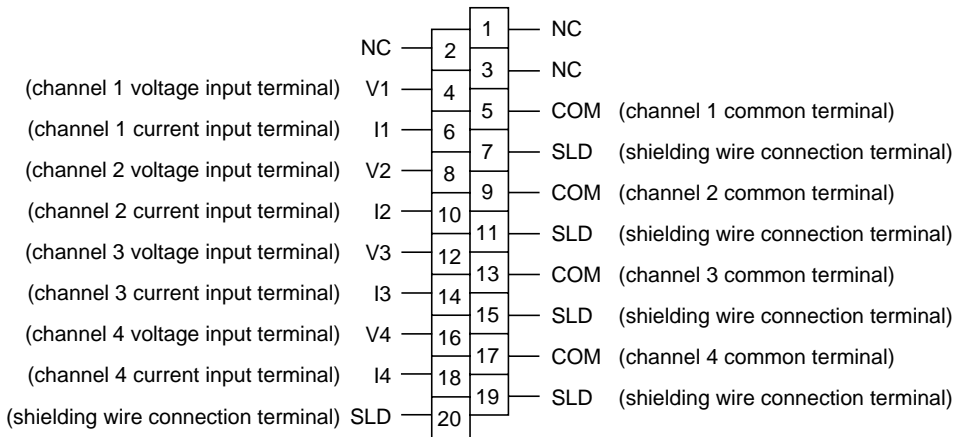

Note: "NC" indicates a terminal not connected to an internal circuit. Do not use NC terminals as repeating terminals.

5-2-2 Wiring example

<For voltage input>

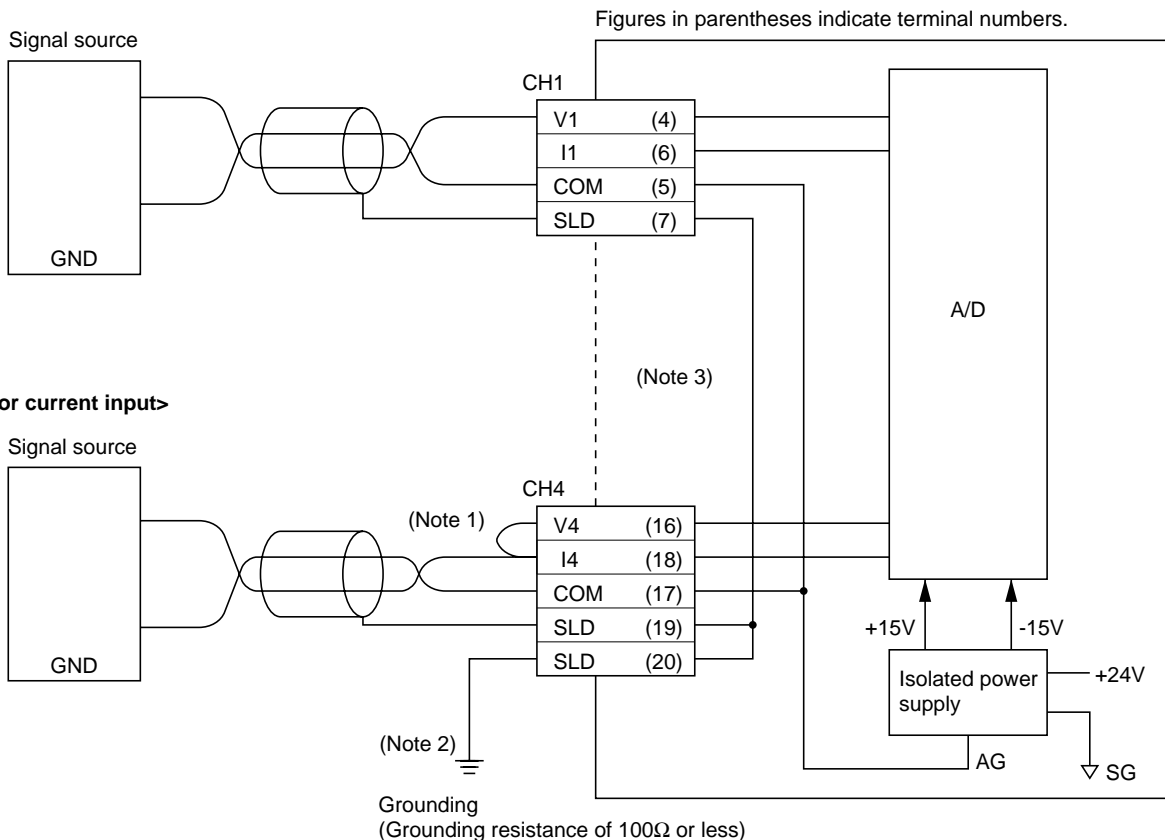

- Note : 1) When current input is used, short-circuit terminals V and I.
 2) When there is excessive noise, ground as grounding resistance of 100Ω or less.
 3) The SLD terminals are connected internally.


5-3 Wiring of Analog Input Module (NP1AX08-MR)

5-3-1 Terminal arrangement


	1	V1 / I1 (channel 1 signal input terminal)
(channel 2 signal input terminal) V2 / I2	2	
	3	COM (channel 1 common terminal)
(channel 2 common terminal) COM	4	
	5	SLD (channel 1, 3 shielding wire connection terminal)
(channel 2, 4 shielding wire connection terminal) SLD	6	
	7	V3 / I3 (channel 3 signal input terminal)
(channel 4 signal input terminal) V4 / I4	8	
	9	COM (channel 3 common terminal)
(channel 4 common terminal) COM	10	
	11	V5 / I5 (channel 5 signal input terminal)
(channel 6 signal input terminal) V6 / I6	12	
	13	COM (channel 5 common terminal)
(channel 6 common terminal) COM	14	
	15	SLD (channel 5, 7 shielding wire connection terminal)
(channel 6, 8 shielding wire connection terminal) SLD	16	
	17	V7 / I7 (channel 7 signal input terminal)
(channel 8 signal input terminal) V8 / I8	18	
	19	COM (channel 7 common terminal)
(channel 8 common terminal) COM	20	

5-3-2 Wiring example

<For voltage input>

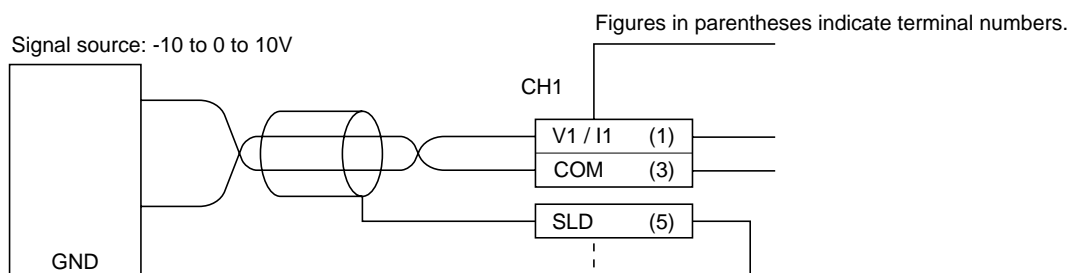

<For current input>

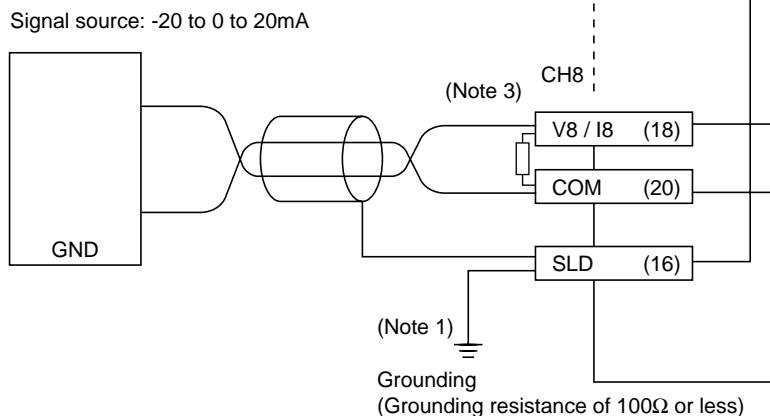

Note : 1) When there is excessive noise, ground as grounding resistance of 100Ω or less.


2) The SLD terminals are connected internally.

3) When used as a current input, connect the resistors supplied with the module between individual VI terminal and COM terminal.

4) For wiring, be sure to use shielded twisted-pair cable. When large size cable is used, the terminal cover may not be able to be closed.


5-4 Wiring of Analog Output Module

5-4-1 Terminal arrangement (NP1AYH2-MR, NP1AY02-MR)

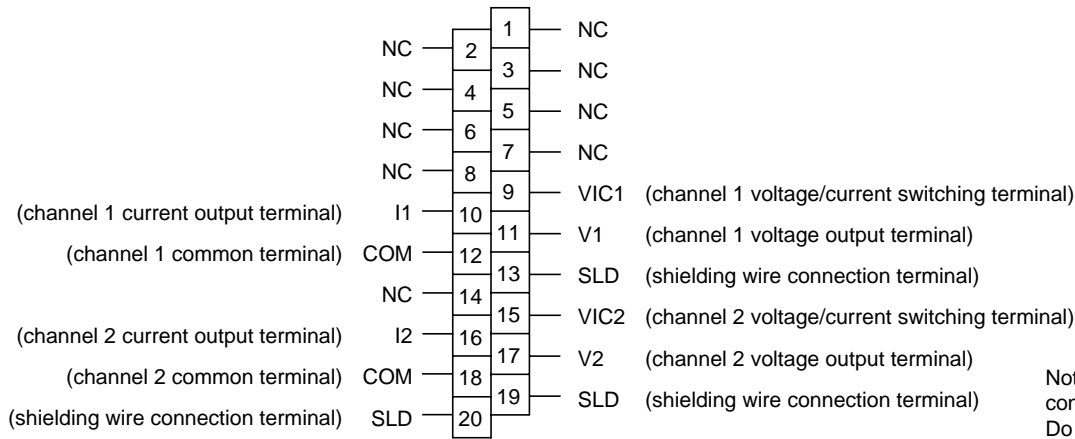

Note: "NC" indicates a terminal not connected to an internal circuit. Do not use NC terminals as repeating terminals.

5-4-2 Wiring example

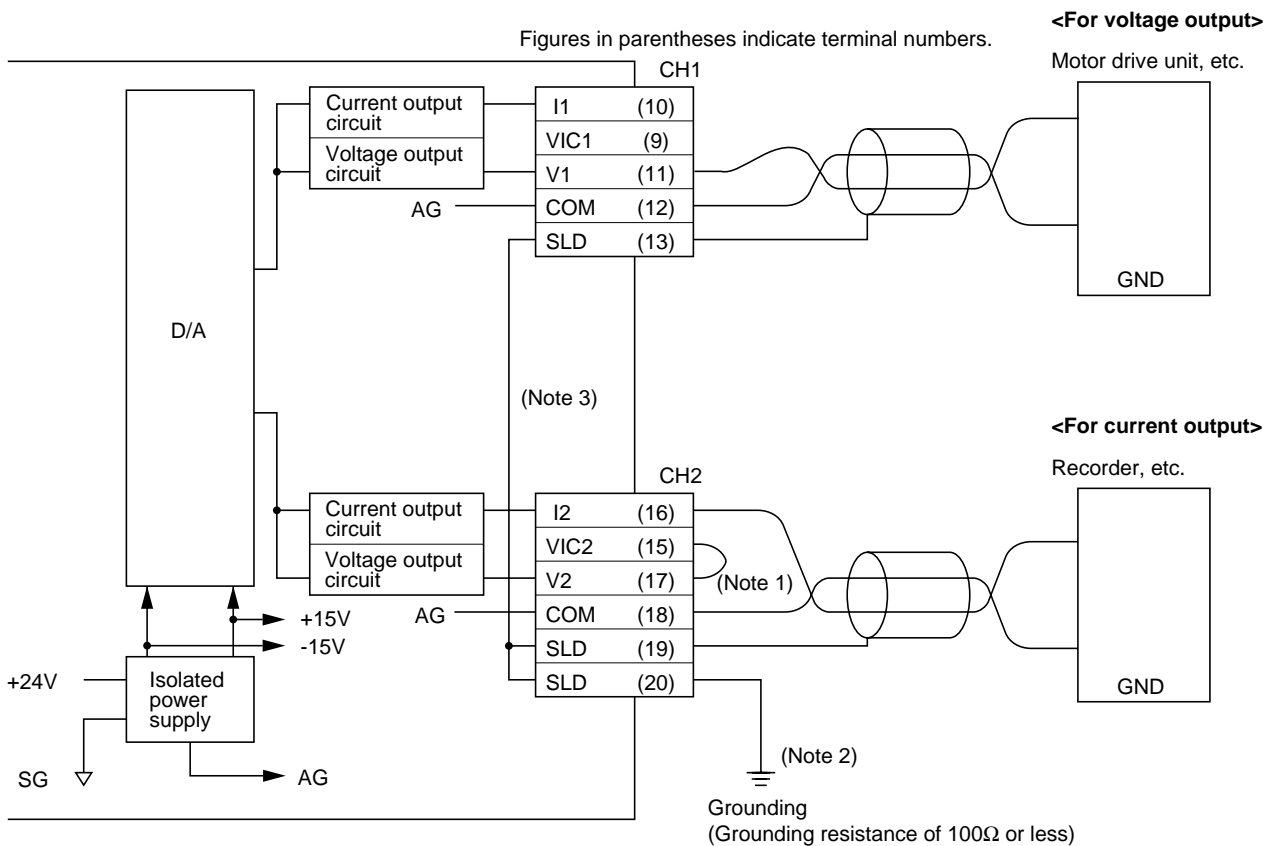

- Note : 1) When current output is used, short-circuit the voltage/current switching terminal and voltage output terminal.
- 2) When there is excessive noise, ground as grounding resistance of 100Ω or less.
- 3) The SLD terminals are connected internally.

Section 6 Gain/Offset Adjustment

	Page
6-1 Gain/Offset Adjustment	6-1
6-1-1 Gain/offset values of analog input module (NP1AXH4-MR, NP1AX04-MR)	6-1
6-1-2 Gain/offset values of analog output module (NP1AYH2-MR, NP1AY02-MR)	6-2
6-2 Adjustment Procedure for Analog Input Module (NP1AXH4-MR, NP1AX04-MR)	6-3
6-3 Adjustment Procedure for Analog Output Module (NP1AYH2-MR, NP1AY02-MR)	6-4

Section 6 Gain/Offset Adjustment

6-1 Gain/Offset Adjustment

The purpose of gain/offset adjustment is to correct any deviation from the selected characteristic range caused by ambient temperature and the performance of electronic parts of an A/D or D/A converter, etc. The gain/offset adjustment should be made for each channel. NP1AX08-MR requires no gain or offset adjustment.

During factory shipment, the gain/offset adjustment is set at the $\pm 10V$ input range for the analog input module and the 1 to 5V output range for the analog output module. When other range is used, gain and offset adjustment is necessary.


6-1-1 Gain/offset values of analog input module (NP1AXH4-MR, NP1AX04-MR)

Offset value: The input voltage/current value that makes the digital output value 0.

Gain value (NP1AXH4-MR): The input voltage/current value that makes the digital output value 8000 or 16000.

Gain value (NP1AX04-MR): The input voltage/current value that makes the digital output value 500 or 1000.

I/O conversion characteristics

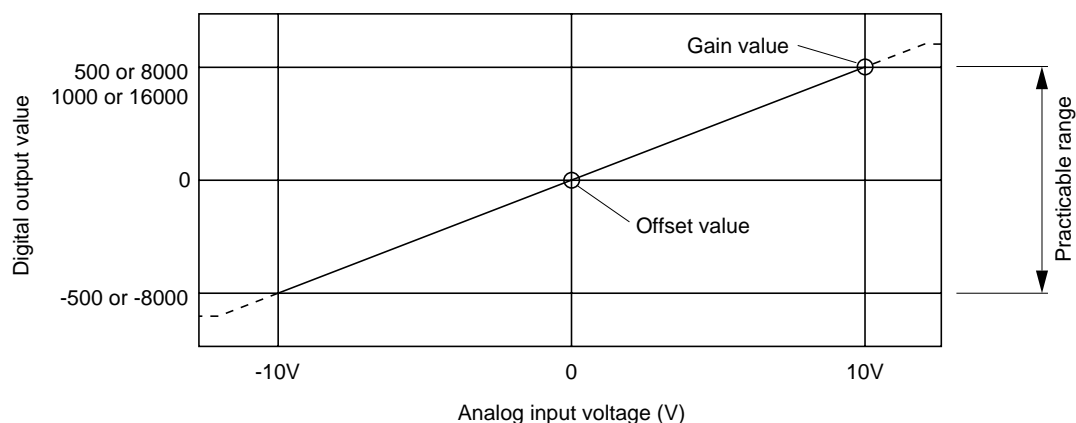

Gain/offset values of analog input module

Analog input range	NP1AXH4-MR			NP1AX04-MR		
		Offset value	Gain value		Offset value	Gain value
$\pm 5V$	-8000	0	8000	-500	0	500
0 to 5V		0	16000		0	1000
1 to 5V		0	16000		0	1000
0 to 10V		0	16000		0	1000
$\pm 10V$	-8000	0	8000	-500	0	500
0 to 20mA		0	16000		0	1000
4 to 20mA		0	16000		0	1000
-20 to 20mA	-8000	0	8000	-500	0	500

6-1 Gain/Offset Adjustment


6-1-2 Gain/offset values of analog output module (NP1AYH2-MR, NP1AY02-MR)

Offset value: The analog output voltage/current value when the value that is D/A-converted is 0.

Gain value (NP1AYH2-MR): The analog output voltage/current value when the value that is D/A-converted is 8000 or 10000.

Gain value (NP1AY02-MR): The analog output voltage/current value when the value that is D/A-converted is 500 or 1000.

I/O conversion characteristics

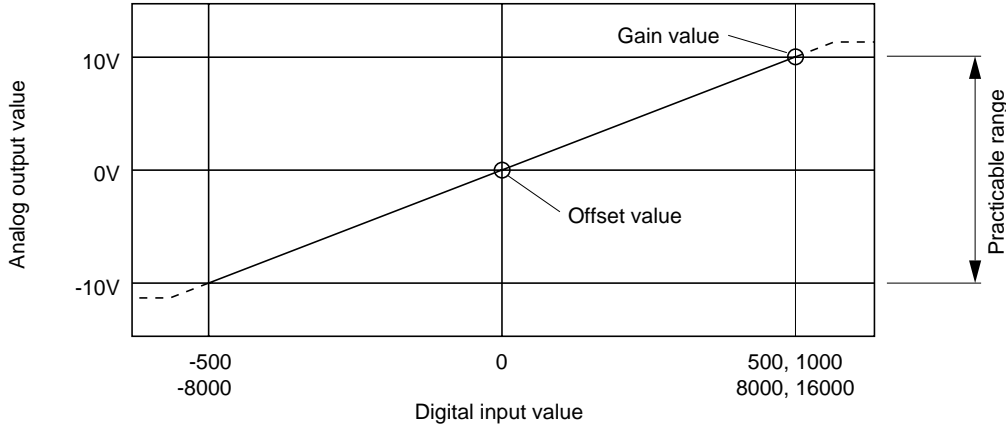


Gain/offset values of analog output module

Analog output range	NP1AYH2-MR			NP1AY02-MR		
		Offset value	Gain value		Offset value	Gain value
± 5V	-8000	0	8000	-500	0	500
0 to 5V		0	16000		0	1000
1 to 5V		0	16000		0	1000
0 to 10V		0	16000		0	1000
± 10V	-8000	0	8000	-500	0	500
0 to 20mA		0	16000		0	1000
4 to 20mA		0	16000		0	1000


Note:

- When current output is used with the analog output module (NP1AYH2-MR, NP1AY02-MR), any currents smaller than 0mA are not output. Therefore, when making the gain/offset adjustment, adjust the gain first, then adjust the offset to 0mA using the UP/DOWN switch. (If the switch is kept pushed to the DOWN side during offset adjustment, the characteristic becomes as shown below.) In doing so, be sure to raise once beyond 0 mA and then lower and stop when 0 mA is reached. If DOWN side is kept pressed for offset adjustment without stopping at this point, the characteristic curve becomes as shown below.

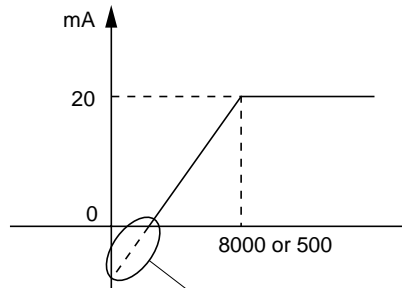

If the switch is kept pushed to the DOWN side


6-2 Adjustment Procedure for Analog Input Module (NP1AXH4-MR, NP1AX04-MR)

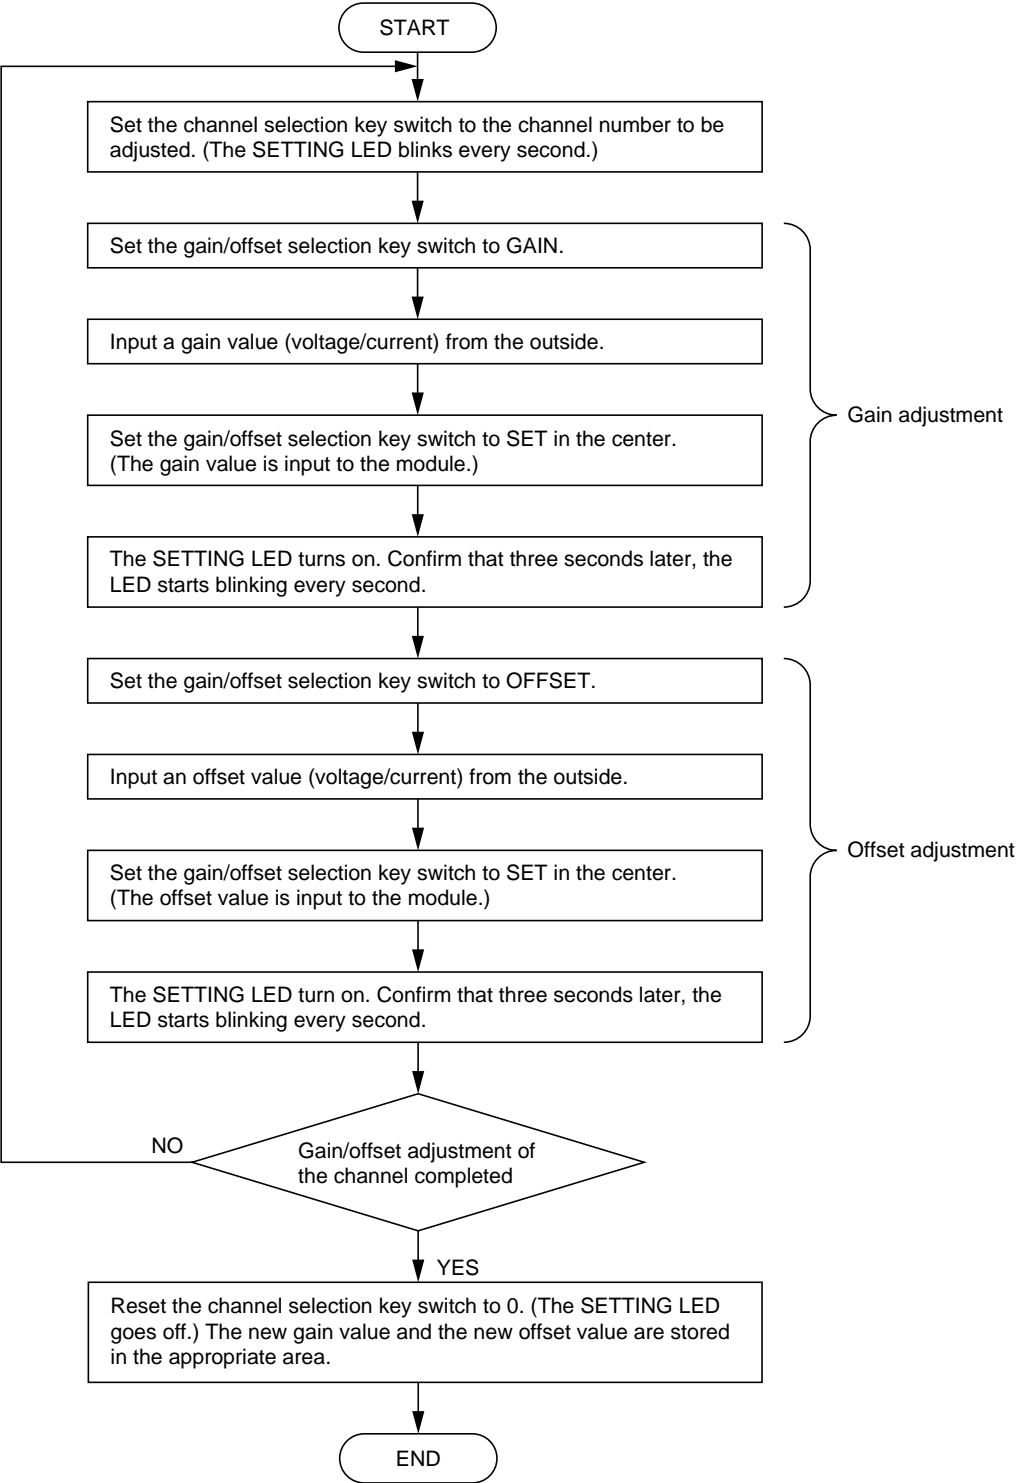

Notes:

- When changing the gain or offset, be sure to set both a gain value and an offset value even if either one does not need to be changed. (To set a gain value (offset value), set the gain/offset selection key switch to the appropriate side.)
- The gain value must be greater than the offset value. Otherwise, a setting error results, causing the error flag, as well as the "Being adjusted" flag, to turn on. To recover from the error, return the channel selection key switch to 0. (In this case, the data that has been set before the change remains enabled.)

6-3 Adjustment Procedure for Analog Output Module (NP1AYH2-MR, NP1AY02-MR)

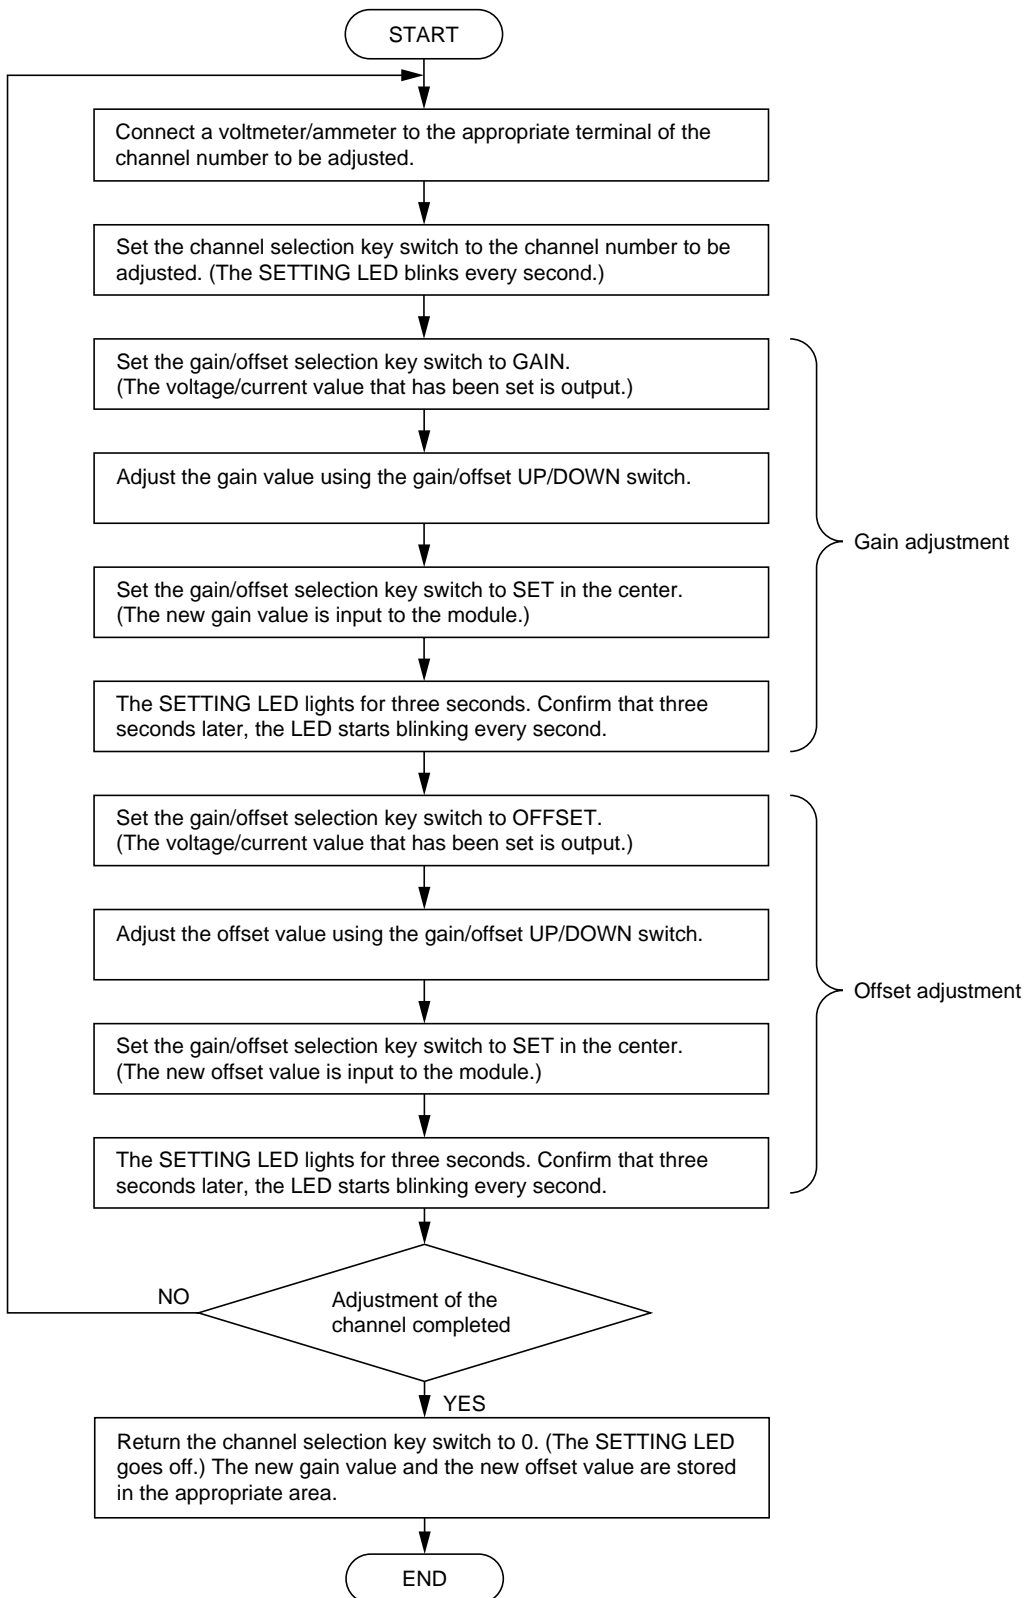

6-3 Adjustment Procedure for Analog Output Module (NP1AYH2-MR, NP1AY02-MR)

Notes:

- When changing the gain or offset, be sure to set both a gain value and an offset value even if either one does not need to be changed. (To set a gain value (offset value), set the gain/offset selection key switch to the appropriate side.)
- The gain value must be greater than the offset value. Otherwise, a setting error results, causing the error flag, as well as the “Being adjusted” flag, to turn on. To recover from the error, return the channel selection key switch to 0. (In this case, the data that has been set before the change remains enabled.)

Fuji Electric Co.,Ltd.

ED & C · Drive Systems Company

Gate City Ohsaki, East Tower, 11-2, Osaki 1-chome, Shinagawa-ku, Tokyo, 141-0032, Japan

Phone: +81-3-5435-7135 ~ 8

Fax: +81-3-5435-7456 ~ 9

URL <http://www.fujielectric.co.jp/kiki/>